

# PyPSA(-Eur): an open-source python environment for state-of-the-art energy system modelling

Iegor Riepin  
(Technische Universität Berlin)


RISE | Gothenburg  
10 September 2025

# What is PyPSA?

## Our research focus:

- **Cost-effective pathways** to reduce greenhouse gas emissions
- **Evaluation** of grid expansion, hydrogen strategies, carbon management strategies
- **Co-optimisation** of generation, storage, conversion and transmission **infrastructure**
- **Algorithms** to improve the tractability of models
- **All open** source and open data


### PyPSA



A python software toolbox for simulating and optimising modern power systems.

[Documentation »](#)


### PyPSA-Eur



A Sector-Coupled Open Optimisation Model of the European Energy System

[Documentation »](#)


### Linopy



Linear optimization interface for N-D labeled variables.

[Documentation »](#)


### Atlite



A Lightweight Python Package for Calculating Renewable Power Potentials and Time Series

[Documentation »](#)


### Powerplantmatching



A toolset for cleaning, standardizing and combining multiple power plant databases.

[Documentation »](#)


### Model Energy



An online toolkit for calculating renewable electricity supplies.


# Application examples

## NGOs and international organisations

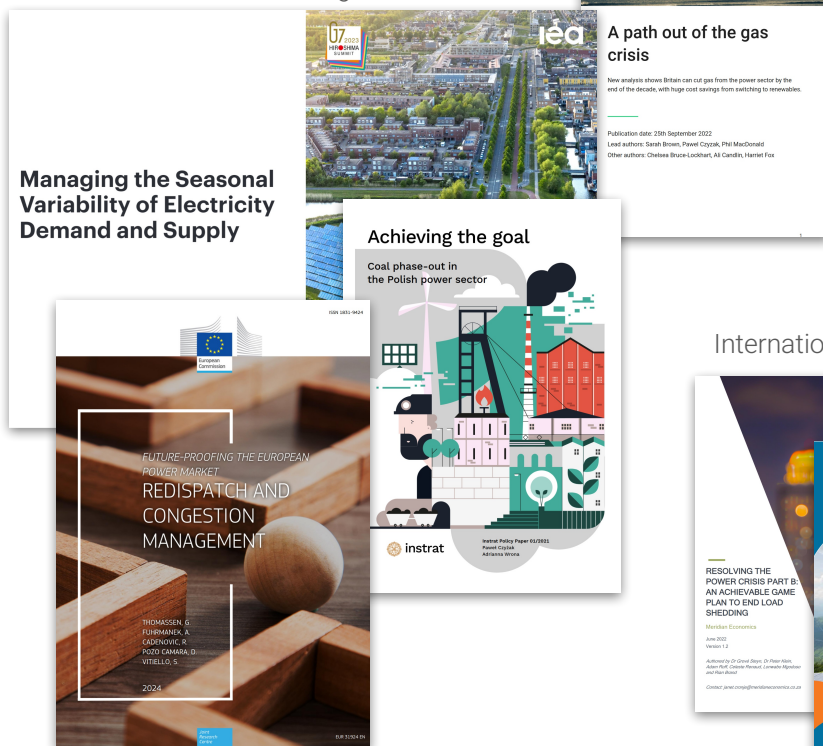

# PyPSA:

## Python for Power System Analysis

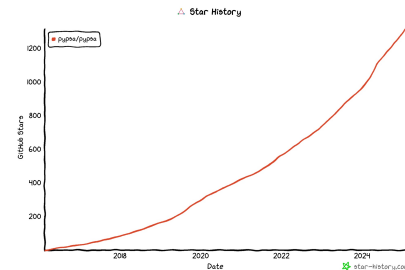

### Capabilities

#### Capacity expansion (linear)

- single-horizon
- multi-horizon

#### Market modelling (linear)

- Linear optimal power flow
- Security-constrained LOPF
- Unit commitment
- Dispatch & redispatch

#### Non-linear power flow

- Newton-Raphson

### With components for

- Electricity transmission networks and pipelines.
- Generators with **unit commitment constraints**
- **Variable** generation with time series (e.g. wind and solar)
- **Storage** with efficiency losses and inflow/spillage for hydro
- **Conversion** between energy carriers (PtX, CHP, BEV, DAC)

### Backend




- all data stored in **pandas**
- framework built for performance with large networks and time series
- Interfaces to major **solvers** (Gurobi, CPLEX, HiGHS, Xpress), with **linopy** (by PyPSA devs)
- Highly **customisable**, but **no GUI**
- Suitable for greenfield, brownfield & pathway studies



# PyPSA-Eur: A sector-coupled open model of the European energy system

Automated **workflow** to build energy system model of Europe from raw open data with high spatial and temporal resolution:

1. OSM transmission lines (>220 kV) + TYNDP
2. a database of existing **power plants**,
3. time series for electricity **demand**,
4. time series for wind/solar **availability**, and
5. geographic wind/solar **potentials**
6. **cost and efficiency** assumptions
7. methods for **model simplification**
8. more for sector-coupled networks like pipelines, LNG terminals, electric vehicles, industry locations, ... (*later*)

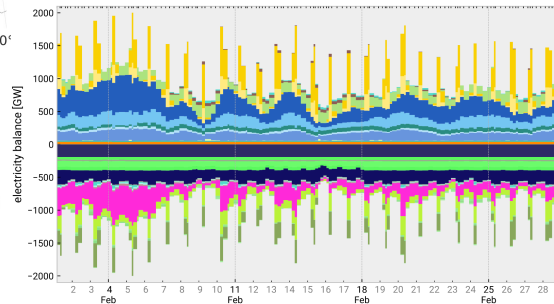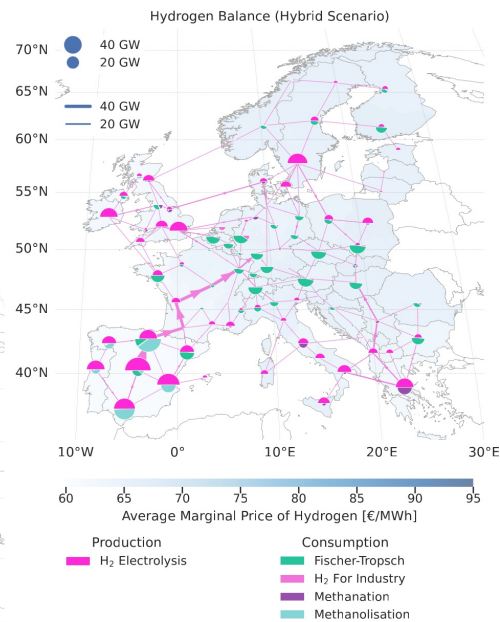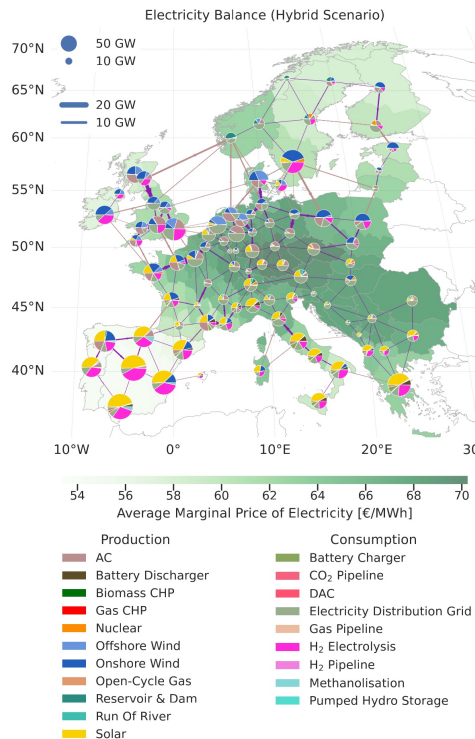

# Energy infrastructure planning in PyPSA as an optimisation problem

Find the long-term cost-optimal energy system, including investments and short-term costs:

$$\text{Min} \left[ \begin{array}{c} \text{Yearly} \\ \text{system costs} \end{array} \right] = \text{Min} \left[ \sum_n \left( \begin{array}{c} \text{Annualised} \\ \text{capital costs} \end{array} \right) + \sum_{n,t} \left( \begin{array}{c} \text{Marginal} \\ \text{costs} \end{array} \right) \right]$$

subject to

- meeting energy demand at each node  $n$  (e.g. region) and time  $t$  (e.g. hour of year)
- transmission constraints between nodes and linearised power flow
- wind, solar, hydro (variable renewables) availability time series  $\forall n, t$
- installed capacity  $\leq$  geographical potentials for renewables
- fulfilling CO<sub>2</sub> emission reduction targets
- Flexibility from gas turbines, battery/hydrogen storage, HVDC links



More on that later!

# Challenges with data-driven modelling

Create a full pipeline of data processing from raw data to results.


- Many different data **sources**
- Many data sources need **cleaning** and **processing**
- Many **intermediate** scripts and datasets
- Data and software **dependencies** need to be managed
- Data and code **change** over time
- Want to be able to **reproduce** results
- Want to run many different **scenarios**

Requires a scalable **workflow management tool!**



**snakemake**

Originally comes from bioinformatics field.

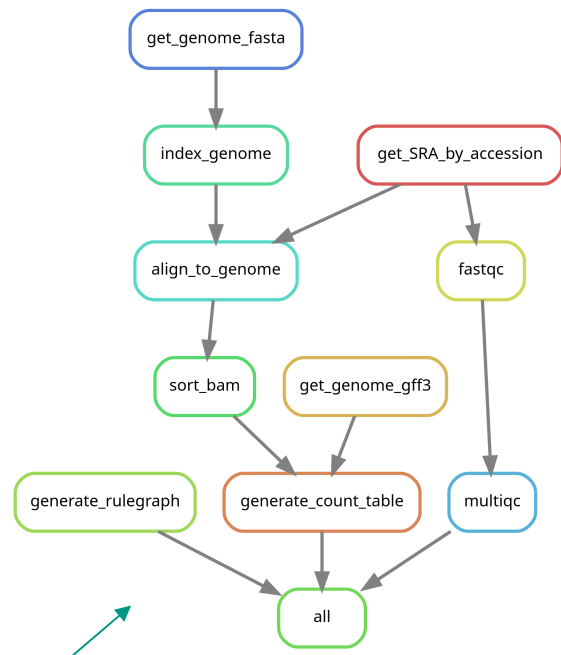


# Miniature example of snakemake

## Snakefile

```
rule mytask:  
  input:  
    "data/{sample}.txt"  
  output:  
    "result/{sample}.txt"  
  script:  
    "scripts/mytask.py"
```

```
rule myplot:  
  input:  
    "result/{sample}.txt"  
  output:  
    "figures/{sample}.pdf"  
  script:  
    "scripts/myplot.py"
```




command:

```
$ snakemake figures/myfigure.pdf
```

# snakemake workflow for the electricity sector



# Simplified workflow structure

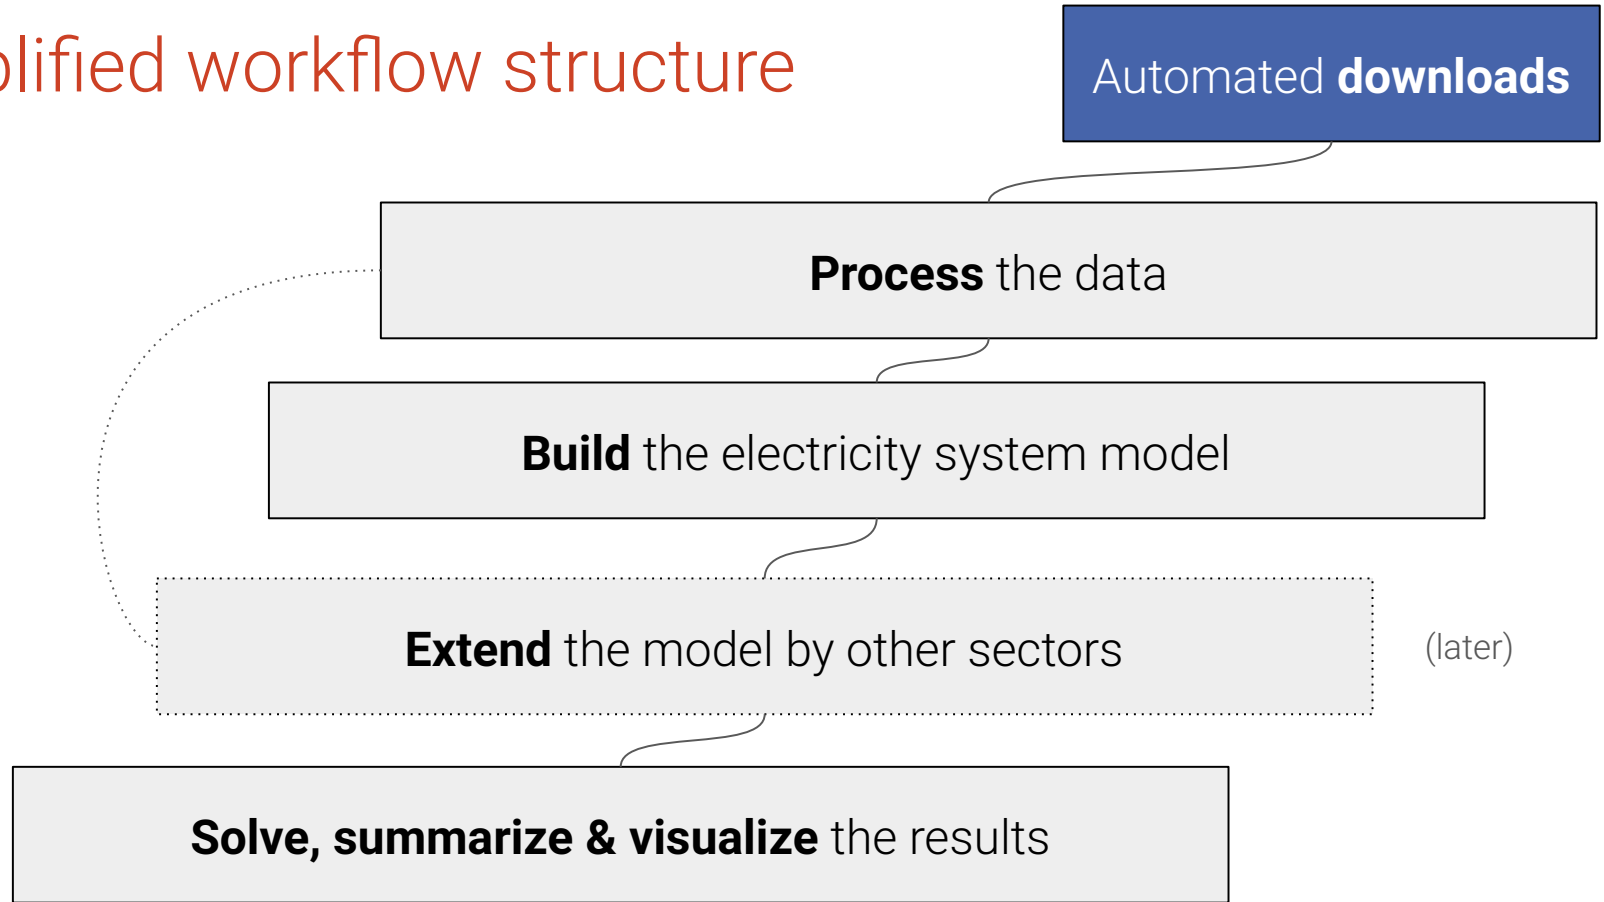




# First, raw data is automatically downloaded.


WDPA



SARAH-3

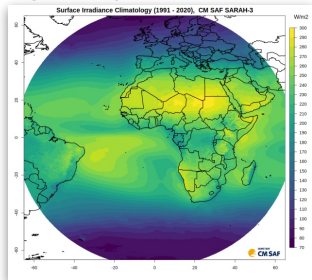


CORINE

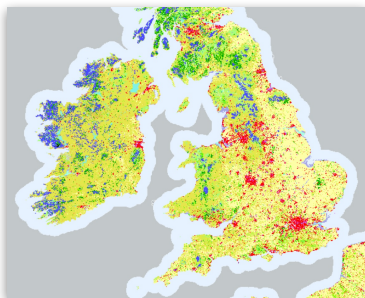


GEBCO




ERA5

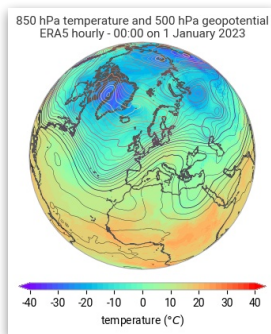


World Bank

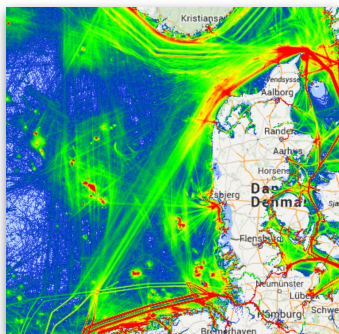

[https://pypsa-eur.readthedocs.io/en/latest/data\\_sources.html](https://pypsa-eur.readthedocs.io/en/latest/data_sources.html)

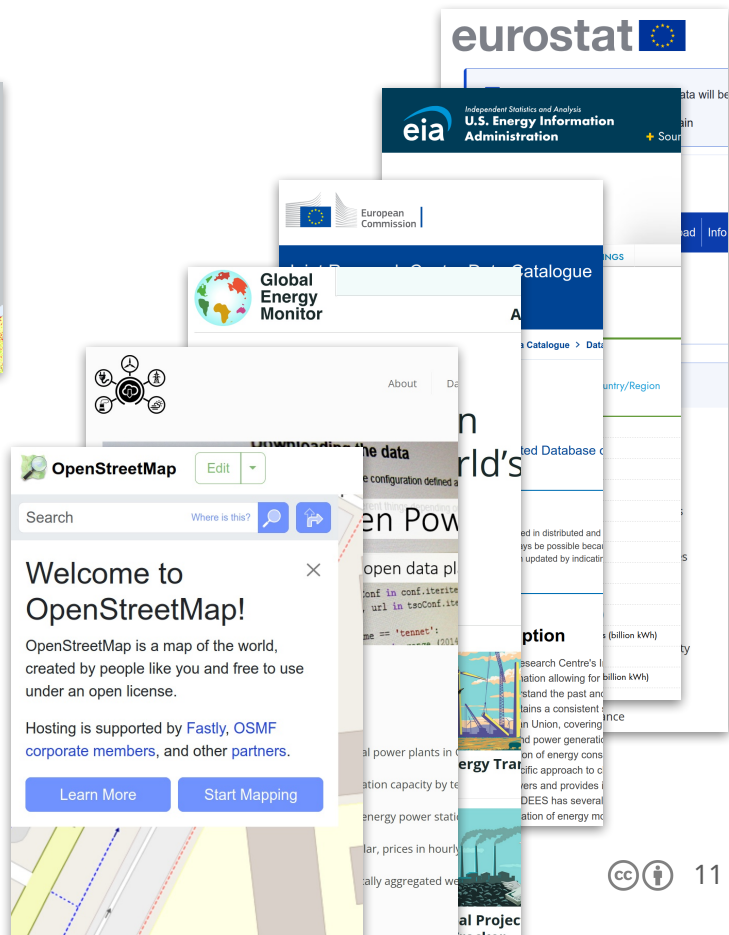

# Simplified workflow structure

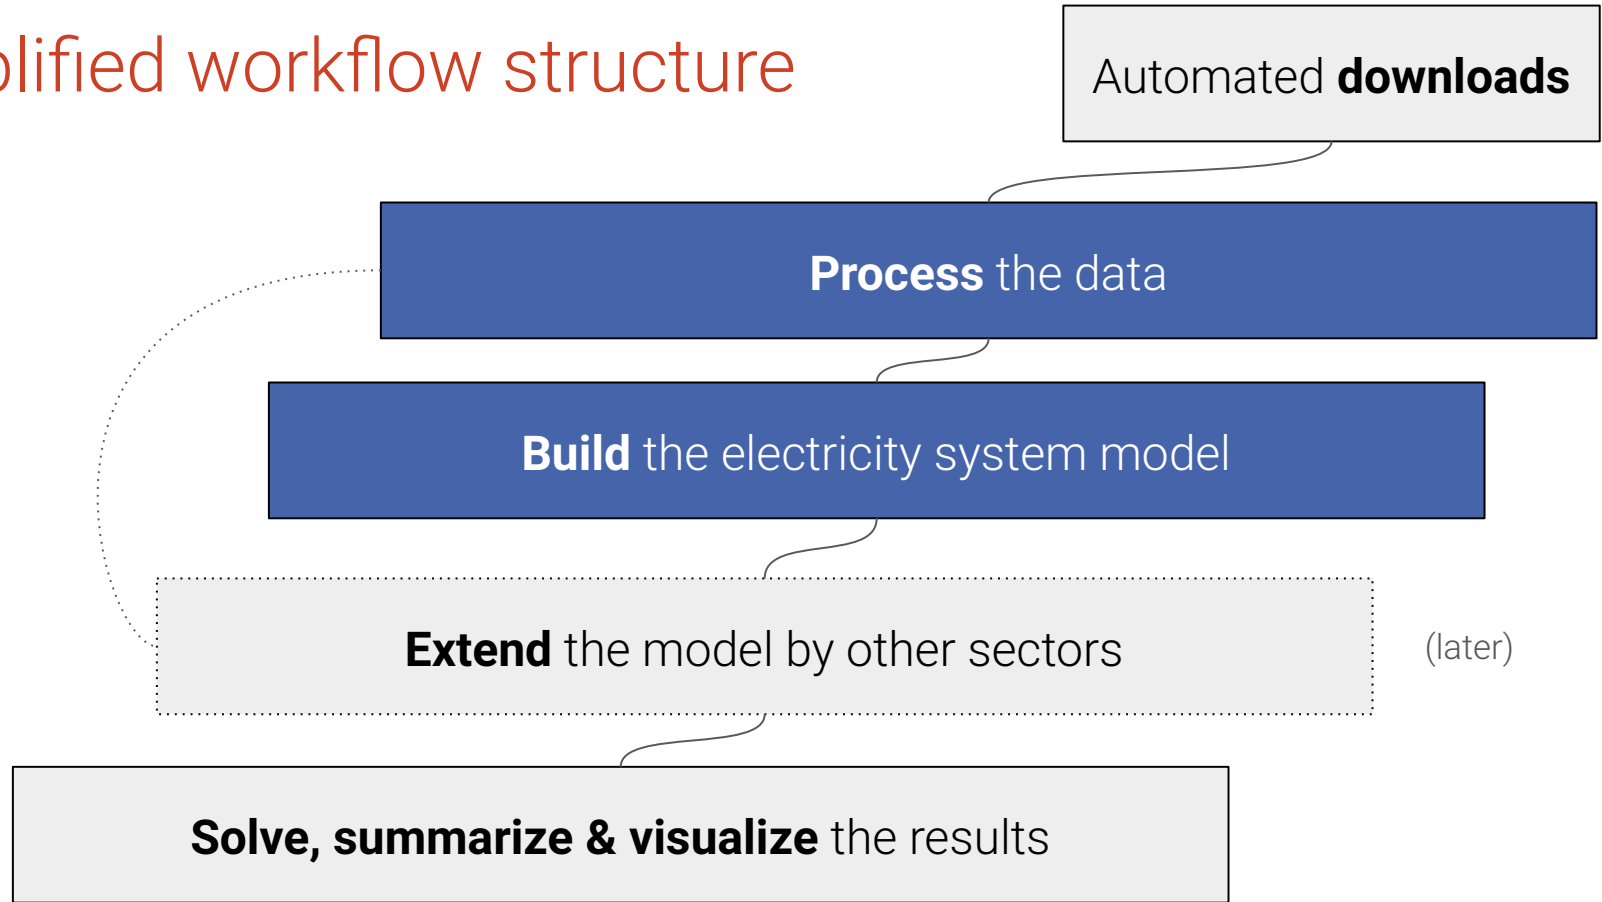

# Steps to building PyPSA-Eur electricity system


Retrieve onshore & offshore **polygons** for each country

**build\_shapes**

Country shapes & exclusive economic zones (EEZ)



NUTS administrative regions (NUTS3)

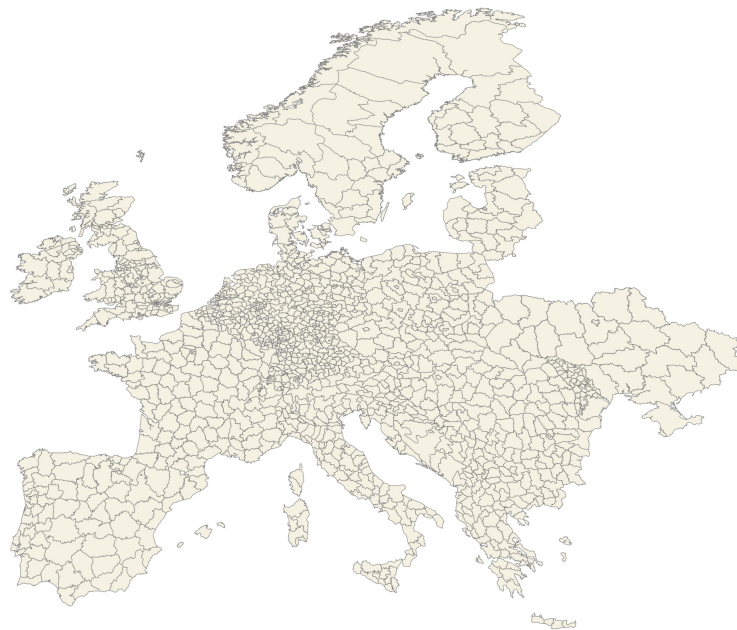


# Steps to building PyPSA-Eur electricity system

|   |   |
|---|---|
| Retrieve onshore & offshore <code>polygons</code> for each country  | <code>build_shapes</code>   |
| Construct a <code>base high-voltage network</code> with buses, transformers, AC & DC lines with DLR & TYNDP | <code>base_network</code> ,<br><code>build_transmission_projects</code> |

# Power grid topology


OpenStreetMap data

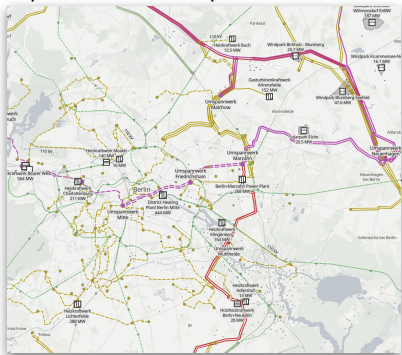

Apply **standard line types** for capacity and parameters.

Calculate **dynamic line rating** potential from weather data.


TYNDP projects

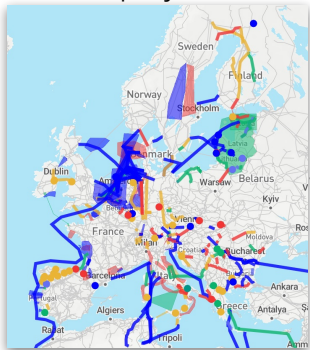

European network with

- ~5,800 buses
- ~7,300 AC lines (>220 kV)
- 36 HVDC links (+TYNDP)

<https://www.nature.com/articles/s41597-025-04550-7>

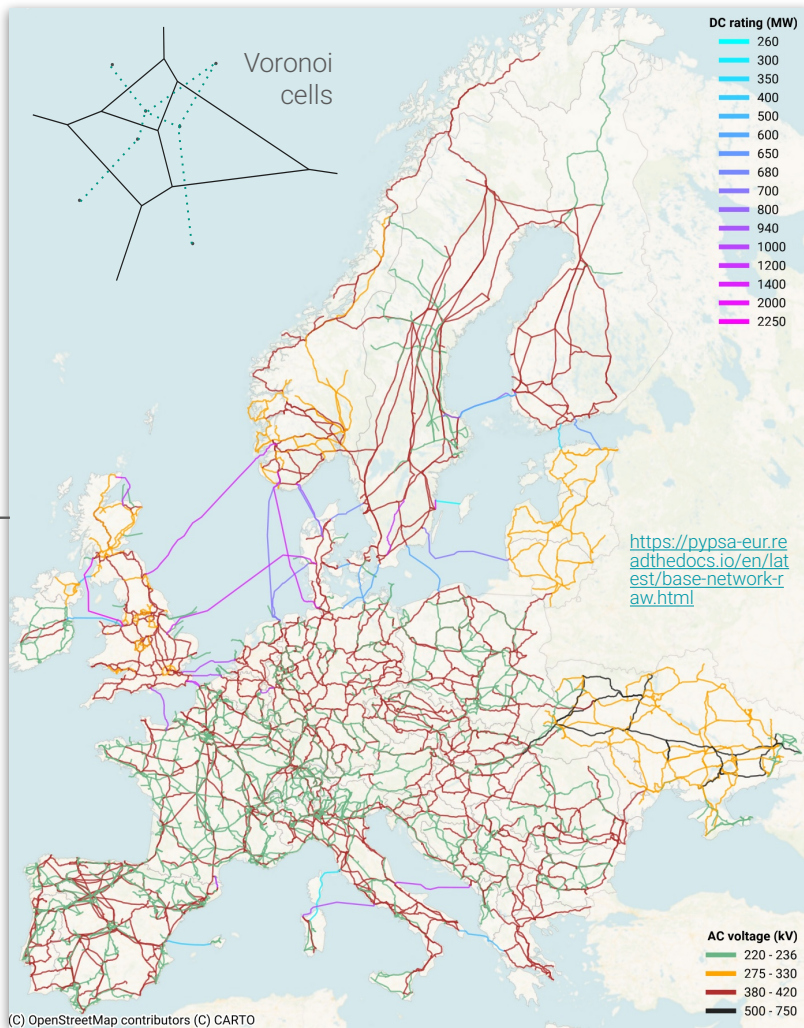

DC rating (MW)

- 260
- 300
- 350
- 400
- 500
- 600
- 650
- 680
- 700
- 800
- 940
- 1000
- 1200
- 1400
- 2000
- 2250

<https://pypsa-eur.readthedocs.io/en/latest/base-network-rw.html>

AC voltage (kV)

- 220 - 236
- 275 - 330
- 380 - 420
- 500 - 750

(C) OpenStreetMap contributors (C) CARTO

# Steps to building PyPSA-Eur electricity system

|   |  |
|---|--|
| Retrieve onshore & offshore <b>polygons</b> for each country  | <b>build_shapes</b>  |
| Construct a <b>base high-voltage network</b> with buses, transformers, AC & DC lines with DLR & TYNDP                       | <b>base_network,</b><br><b>build_transmission_projects</b> |
| Transform all transmission lines to 380kV, remove dead ends & cluster with <b>k-means</b> or <b>hierarchical</b> clustering | <b>simplify_network,</b><br><b>cluster_network</b>         |




# Clustering the electricity network: `simplify_network`

Need to make the optimization problem less **computationally challenging**...

...if we want to **co-optimize** generation, storage, PtX conversion and transmission infrastructure:

1. Lift all lines to **common voltage** level of 380 kV.
2. Remove **dead ends**.

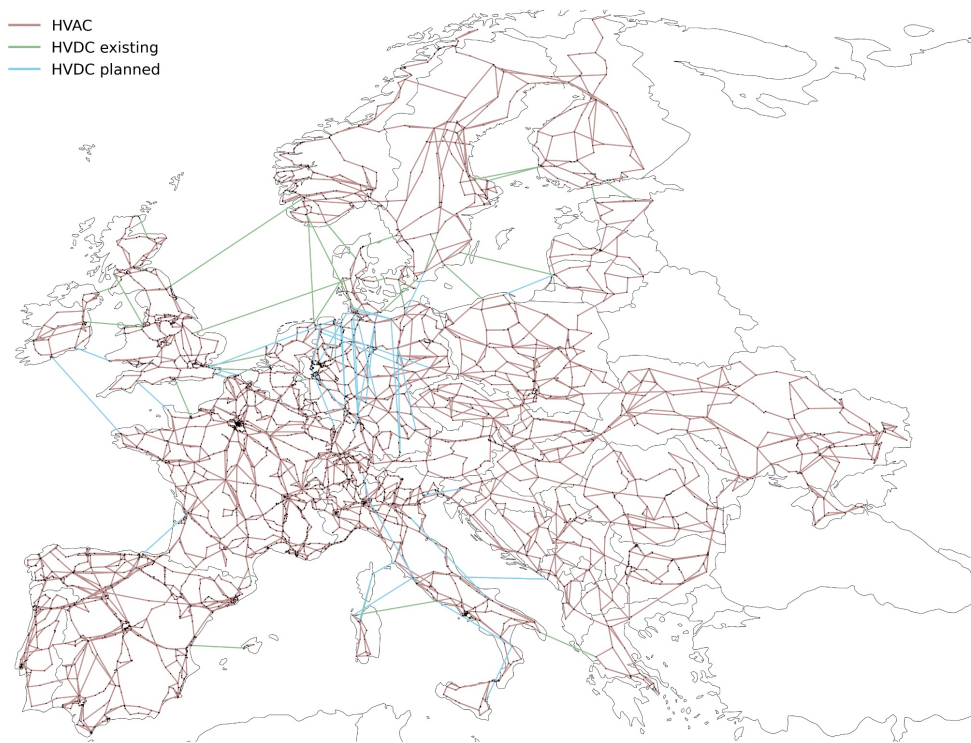


# Clustering the electricity network: `cluster_network`

— HVAC  
— HVDC operational  
— HVDC considered

Transformed  
to 380 kV

Clustered to  
512 regions


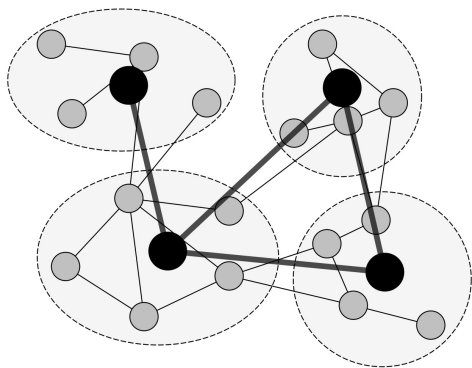


# Clustering the electricity network: `cluster_network`

— HVAC  
— HVDC operational  
— HVDC considered

Transformed  
to 380 kV

Clustered to  
256 regions

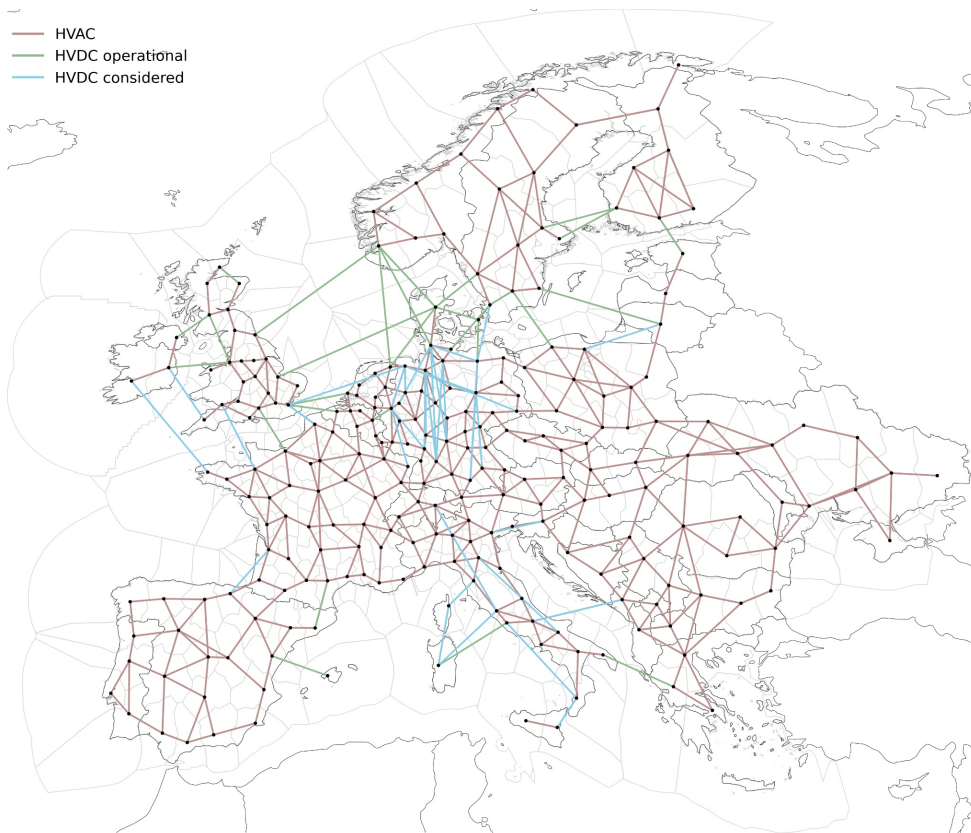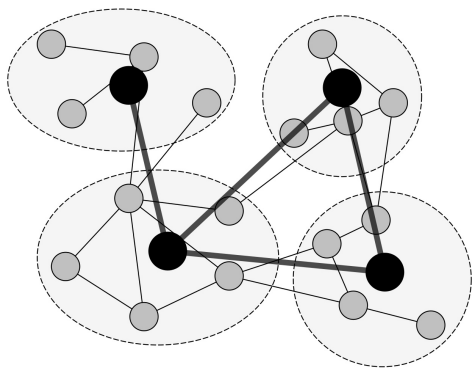


# Clustering the electricity network: `cluster_network`

— HVAC  
— HVDC operational  
— HVDC considered

Transformed  
to 380 kV

Clustered to  
128 regions

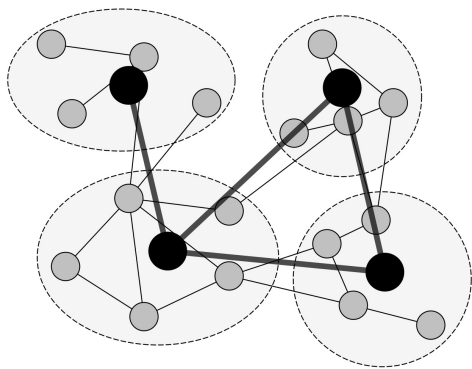


# Clustering the electricity network: `cluster_network`

— HVAC  
— HVDC operational  
— HVDC considered

Transformed  
to 380 kV

Clustered to  
64 regions

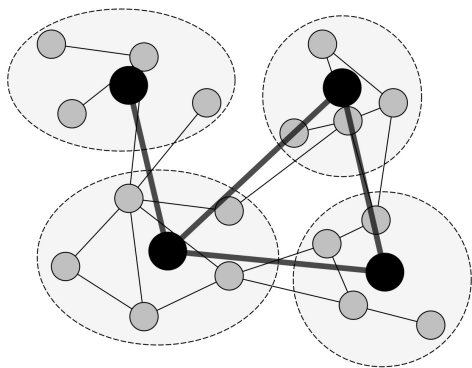




# Clustering the electricity network: `cluster_network`

— HVAC  
— HVDC operational  
— HVDC considered

Transformed  
to 380 kV

Clustered to  
41 regions

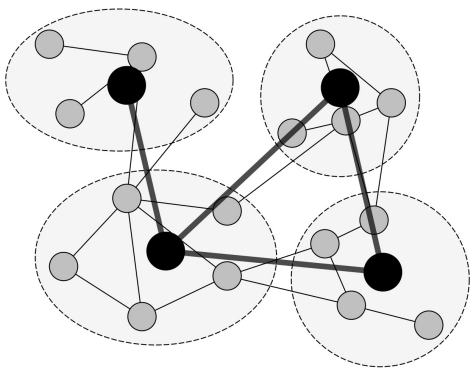



# Steps to building PyPSA-Eur electricity system

|   |  |
|---|--|
| Retrieve onshore & offshore <b>polygons</b> for each country  | <code>build_shapes</code>  |
| Construct a <b>base high-voltage network</b> with buses, transformers, AC & DC lines with DLR & TYNDP                       | <code>base_network,</code><br><code>build_transmission_projects</code>     |
| Transform all transmission lines to 380kV, remove dead ends & cluster with <b>k-means</b> or <b>hierarchical</b> clustering | <code>simplify_network,</code><br><code>cluster_network</code>             |
| Determine <b>eligible areas</b> for utility-scale PV & onshore/offshore wind park development                               | <code>determine_availability_matrix</code>                                 |
| Build renewable <b>capacity factor profiles</b> for each clustered region based on land availability                        | <code>build_renewable_profiles,</code><br><code>build_hydro_profile</code> |

# atlite: Convert weather data to energy systems data

Rule: build\_renewable  
profiles


pypi v0.3.0 conda-forge v0.3.0 Tests passing codecov 72% docs passing license MIT  
REUSE compliant JOSS 10.21105/joss.03294 chat 52 online stackoverflow pypsa questions 44

Python library for converting **weather data** (e.g. wind, solar radiation, temperature, precipitation) into **energy systems data**:


- solar photovoltaics
- solar thermal collectors
- wind turbines
- hydro run-off, reservoir, dams
- heat pump COPs
- dynamic line rating (DLR)
- heating and cooling demand (HDD/CDD)

It can also perform **land eligibility analyses**.

## 1. Create Cutout (Select spatio-temporal bounds)


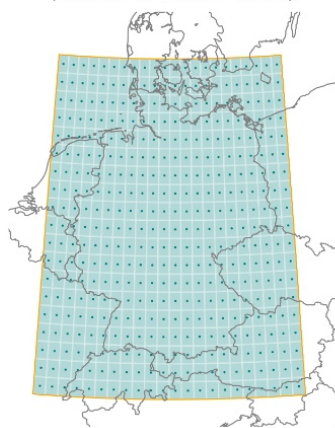


## 2. Prepare Cutout (Retrieve data per weather cell)

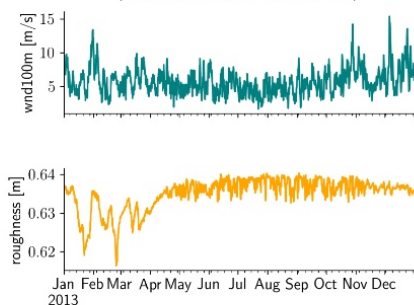

⋮


## 3. Convert Cutout (Calculate potentials and timeseries per region)

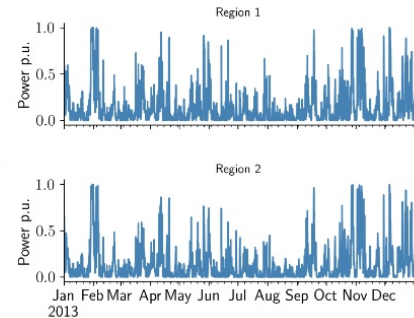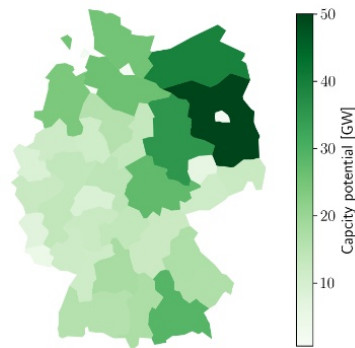

⋮


# Time series for renewables

Historical meteorological weather data from ERA5 and SARA3-3  
(up to 84 years, 30x30 km)

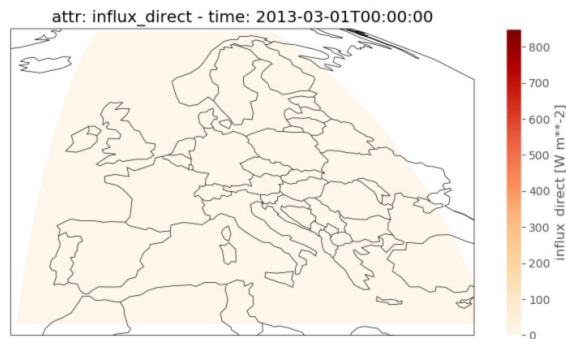

## Solar panel models

- orientation
- material

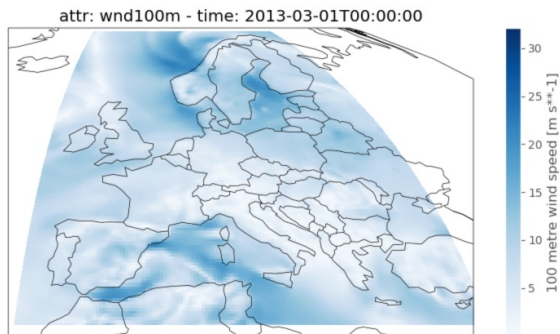



## Wind turbine models

- power curve
- surface roughness

atlite: Convert weather data to  
energy systems data

pypl v0.3.0 conda-forge v0.3.0 Tests passing codecov 72% docs passing license MIT  
REUSE compliant JOSS 10.21105/joss.03294 chat 52 online stackoverflow pypsa questions 44

Wind and solar capacity factors

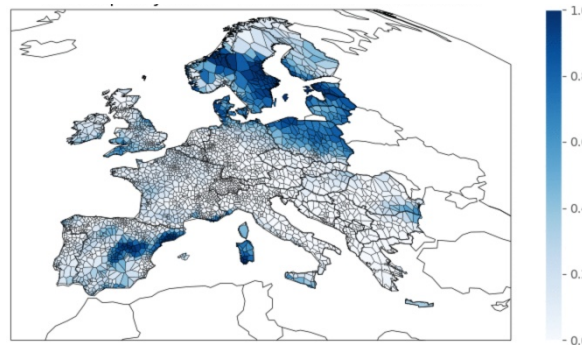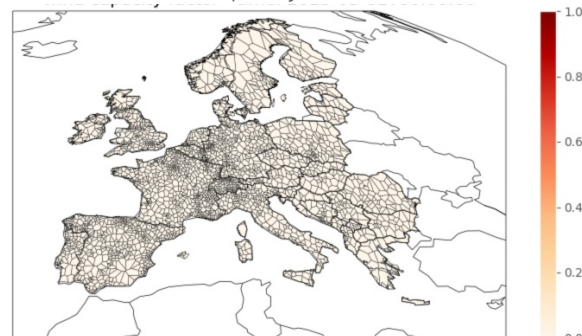

# Land availability for renewables



**Example:**  
Onshore wind  
in one clustered  
region



atlite: Convert weather data to energy systems data

pypl v0.3.0 conda-forge v0.3.0 Tests passing codecov 72% docs passing license MIT  
REUSE compliant JOSS 10.21105/joss.03294 chat 52 online stackoverflow pypsa questions 44

- CORINE / LUISA land cover
  - eligible land types
  - distance requirements
- NATURA / WDPA natural protection areas
- GEBCO bathymetry data
- Shipping lanes
- Distance to shore


# Steps to building PyPSA-Eur electricity system

|   |  |
|---|--|
| Retrieve onshore & offshore <b>polygons</b> for each country  | <code>build_shapes</code>  |
| Construct a <b>base high-voltage network</b> with buses, transformers, AC & DC lines with DLR & TYNDP                       | <code>base_network,</code><br><code>build_transmission_projects</code>     |
| Transform all transmission lines to 380kV, remove dead ends & cluster with <b>k-means</b> or <b>hierarchical</b> clustering | <code>simplify_network,</code><br><code>cluster_network</code>             |
| Determine <b>eligible areas</b> for utility-scale PV & onshore/offshore wind park development                               | <code>determine_availability_matrix</code>                                 |
| Build renewable <b>capacity factor profiles</b> for each clustered region based on land availability                        | <code>build_renewable_profiles,</code><br><code>build_hydro_profile</code> |
| Prepare existing renewables and fossil <b>power plants</b>  | <code>build_powerplants</code>   |



# Welcome to powerplantmatching's documentation!

<https://globalenergymonitor.org/projects/global-integrated-power-tracker/tracker-map/>



pypi v0.7.0 conda-forge v0.7.0 python >=3.9 Tests failing docs passing pre-commit.ci passed Ruff  
license GPLv3+ DOI 10.5281/zenodo.3358985 stackoverflow pypsa questions 44

A toolset for cleaning, standardizing and combining multiple power plant databases.


```
import powerplantmatching as pm
df = pm.powerplants(from_url=True)
df.query("DateIn > 2000")
```

## Sources

- Global Energy Monitor (GEM)
- [Open Power System Data](#) (OPSD)
- [Global Energy Observatory](#)
- World Resources Institute
- Marktstammdatenregister (MaStR)
- CARMA
- ENTSO-E, BNetzA, UBA, IRENA
- JRC for hydro power plants

## Attributes

- name
- fuel type
- technology
- country
- capacity
- commissioning year
- retirement year
- coordinates

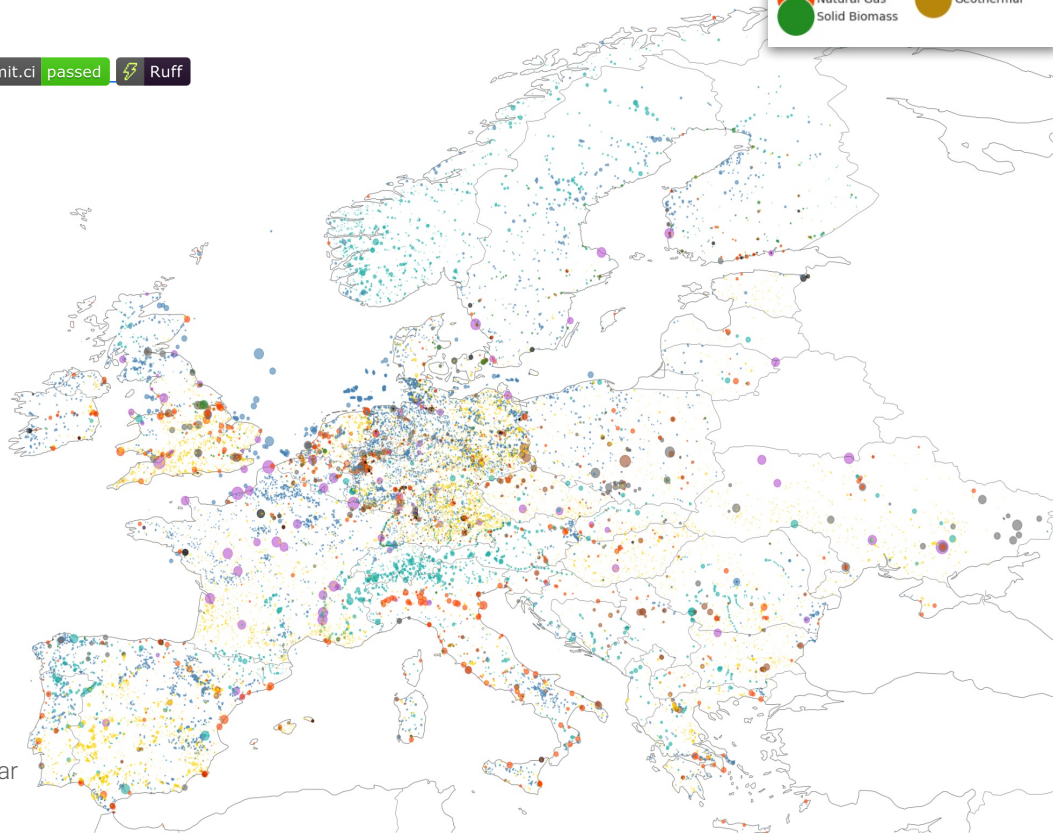

[github.com/pypsa/powerplantmatching](https://github.com/pypsa/powerplantmatching)





# Steps to building PyPSA-Eur electricity system

|   |  |
|---|--|
| Retrieve onshore & offshore <b>polygons</b> for each country  | <code>build_shapes</code>  |
| Construct a <b>base high-voltage network</b> with buses, transformers, AC & DC lines with DLR & TYNDP                       | <code>base_network,</code><br><code>build_transmission_projects</code>     |
| Transform all transmission lines to 380kV, remove dead ends & cluster with <b>k-means</b> or <b>hierarchical</b> clustering | <code>simplify_network,</code><br><code>cluster_network</code>             |
| Determine <b>eligible areas</b> for utility-scale PV & onshore/offshore wind park development                               | <code>determine_availability_matrix</code>                                 |
| Build renewable <b>capacity factor profiles</b> for each clustered region based on land availability                        | <code>build_renewable_profiles,</code><br><code>build_hydro_profile</code> |
| Prepare existing renewables and fossil <b>power plants</b>  | <code>build_powerplants</code>   |
| Add generation, storage and demand to the network with <b>techno-economic assumptions</b> on costs and efficiencies, ...    | <code>add_electricity,</code><br><code>prepare_network</code>              |

# Open database of techno-economic assumptions

- compiles **techno-economic assumptions** on energy system components
  - investment costs, FOM/VOM costs, efficiencies, lifetimes
  - for given years, e.g. 2020, 2030, 2040, 2050
  - from mixed sources, but prioritising **Danish Energy Agency** where available (and sensible)

| Preview Code Blame 1997 lines (1997 loc) · 213 KB |                 |                     |             |               |   | Raw Download Edit |  |
|---|-----------------|---------------------|-------------|---------------|---|-------------------|--|
| Q fischer-tropsch                                 |                 |                     |             |               |   |                   |  |
| 1   | technology      | parameter           | value       | unit          | source  | ft                |  |
| 217   | Fischer-Tropsch | FOM                 | 3.0         | %/year        | Agora Energiewende (2018): The Future Cost of Electricity-Based Synthetic Fuels ( <a href="https://www.agora-energiewende.de/en/publications/the-future-cost-of-electricity-based-synthetic-fuels-1/">https://www.agora-energiewende.de/en/publications/the-future-cost-of-electricity-based-synthetic-fuels-1/</a> ), section 6.3.2.1.               |                   |  |
| 218   | Fischer-Tropsch | VOM                 | 4.4663      | EUR/MWh_FT    | Danish Energy Agency, data_sheets_for_renewable_fuels.xlsx  | 11                |  |
| 219   | Fischer-Tropsch | capture rate        | 0.9         | per unit      | Assumption based on doi:10.1016/j.biombioe.2015.01.006  |                   |  |
| 220   | Fischer-Tropsch | carbondioxide-input | 0.326       | t_CO2/MWh_FT  | DEA (2022): Technology Data for Renewable Fuels ( <a href="https://ens.dk/en/our-services/projections-and-models/technology-data/technology-data-renewable-fuels">https://ens.dk/en/our-services/projections-and-models/technology-data/technology-data-renewable-fuels</a> ), Hydrogen to Jet Fuel, Table 10 / pg. 267.                              | Ir                |  |
| 221   | Fischer-Tropsch | efficiency          | 0.799       | per unit      | Agora Energiewende (2018): The Future Cost of Electricity-Based Synthetic Fuels ( <a href="https://www.agora-energiewende.de/en/publications/the-future-cost-of-electricity-based-synthetic-fuels-1/">https://www.agora-energiewende.de/en/publications/the-future-cost-of-electricity-based-synthetic-fuels-1/</a> ), section 6.3.2.2.               |                   |  |
| 222   | Fischer-Tropsch | electricity-input   | 0.007       | MWh_el/MWh_FT | DEA (2022): Technology Data for Renewable Fuels ( <a href="https://ens.dk/en/our-services/projections-and-models/technology-data/technology-data-renewable-fuels">https://ens.dk/en/our-services/projections-and-models/technology-data/technology-data-renewable-fuels</a> ), Hydrogen to Jet Fuel, Table 10 / pg. 267.                              | 0.                |  |
| 223   | Fischer-Tropsch | hydrogen-input      | 1.421       | MWh_H2/MWh_FT | DEA (2022): Technology Data for Renewable Fuels ( <a href="https://ens.dk/en/our-services/projections-and-models/technology-data/technology-data-renewable-fuels">https://ens.dk/en/our-services/projections-and-models/technology-data/technology-data-renewable-fuels</a> ), Hydrogen to Jet Fuel, Table 10 / pg. 267.                              | 0.                |  |
| 224   | Fischer-Tropsch | investment          | 703726.4462 | EUR/MW_FT     | Agora Energiewende (2018): The Future Cost of Electricity-Based Synthetic Fuels ( <a href="https://www.agora-energiewende.de/en/publications/the-future-cost-of-electricity-based-synthetic-fuels-1/">https://www.agora-energiewende.de/en/publications/the-future-cost-of-electricity-based-synthetic-fuels-1/</a> ), table 8: "Reference scenario". | W                 |  |
| 225   | Fischer-Tropsch | lifetime            | 20.0        | years         | Danish Energy Agency, Technology Data for Renewable Fuels (04/2022), Data sheet "Methanol to Power".  |                   |  |
| 956   | methanation     | lifetime            | 20.0        | years         | Guesstimate.  | B                 |  |

[https://github.com/PyPSA/technology-data/blob/master/outputs/costs\\_2030.csv](https://github.com/PyPSA/technology-data/blob/master/outputs/costs_2030.csv)

# Temporal aggregation

Multiple options:


1. **averaging** of every Nth hour
2. **sampling** every Nth hour (e.g. 3-hourly)
3. Non-equidistant **segmentation** with pre-defined number of segments using the **tsam** Python library from **FZ Jülich**

Introduction




tsam - time series aggregation module

<https://tsam.readthedocs.io/en/latest/newsDoc.html>

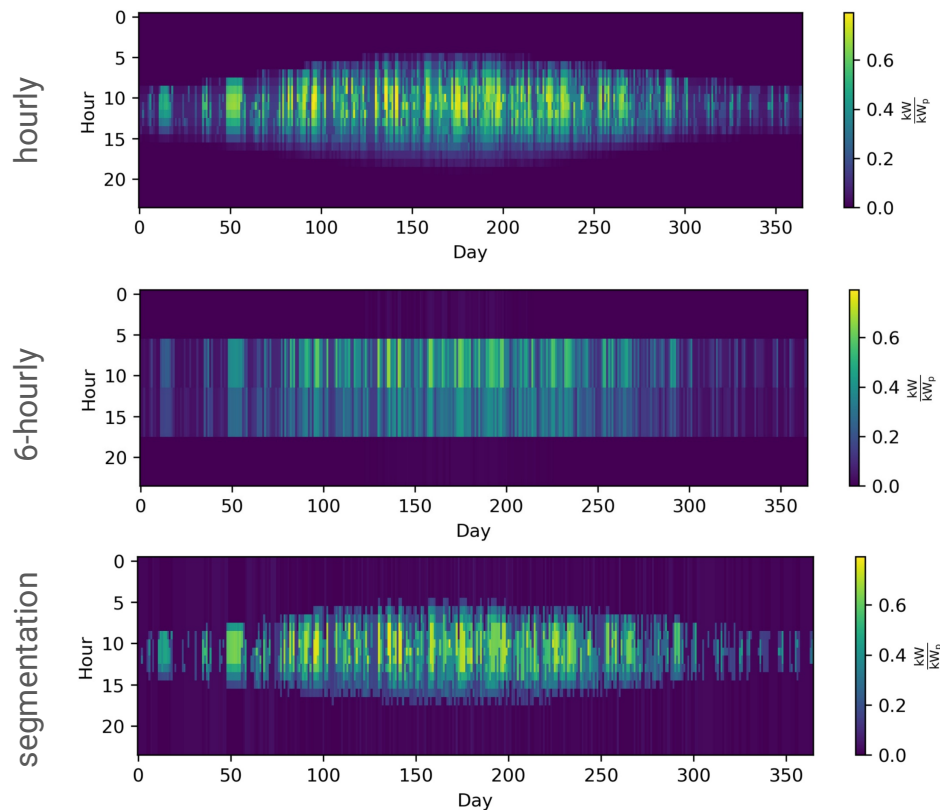

# Simplified workflow structure

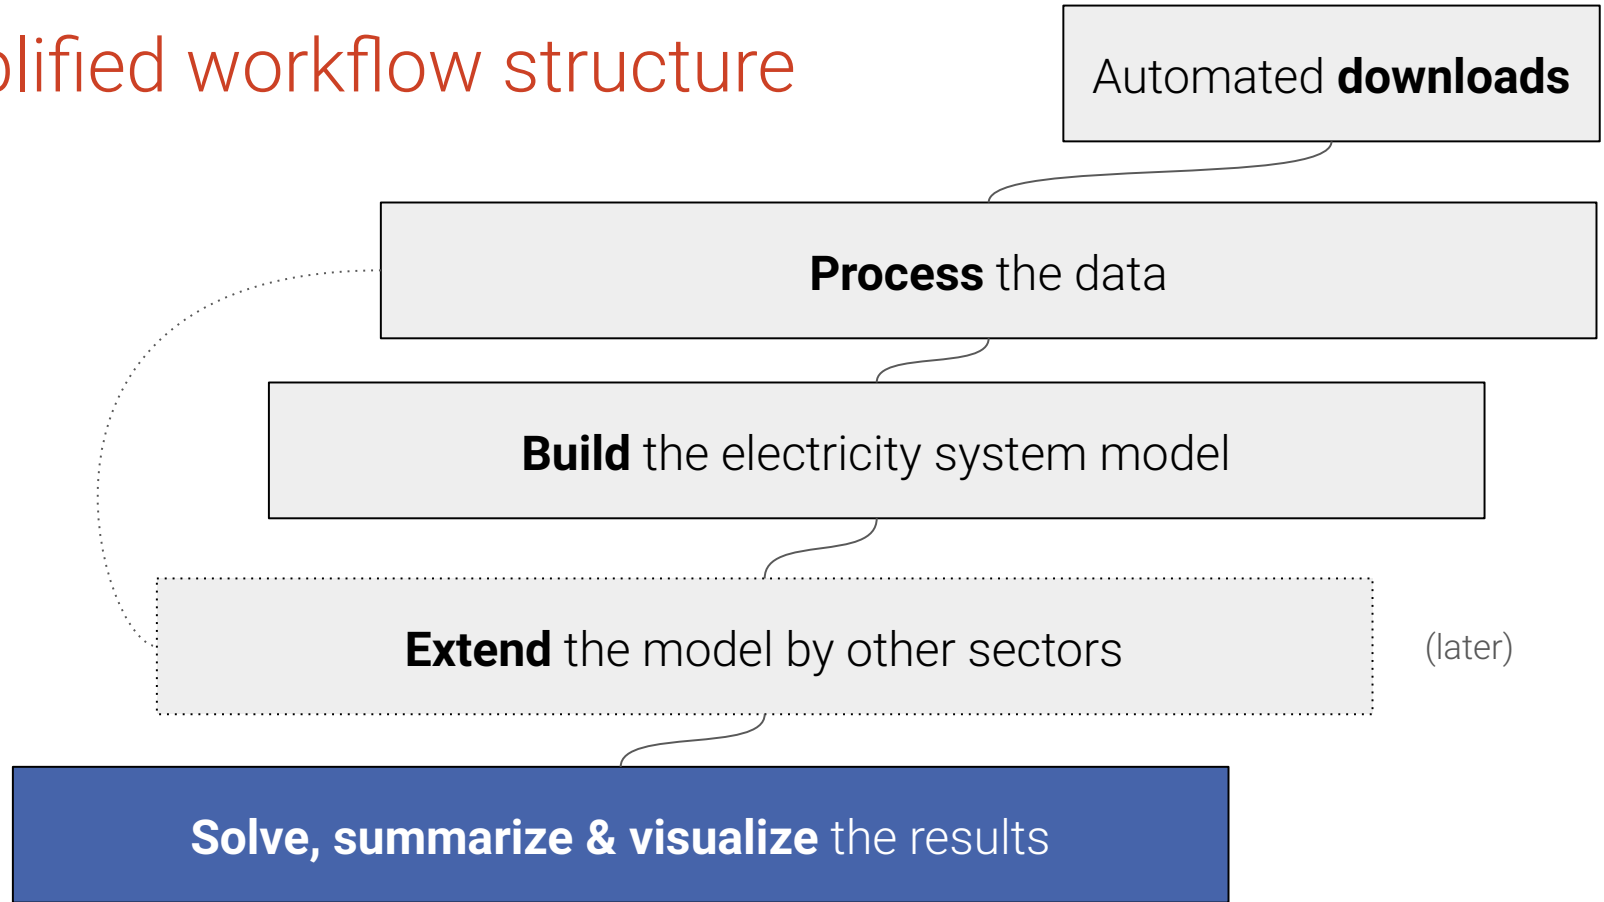

# linopy: Linear optimization with N-D labeled variables


pypi v0.5.0 CI license MIT

Python library that facilitates **optimization** with real-world, large-scale data.

It supports:

- Linear (LP),
- Mixed-Integer (MILP),
- Quadratic programming (QP).

It has been developed to make linear programming in Python easy, highly-flexible and – most importantly – **highly performant**.

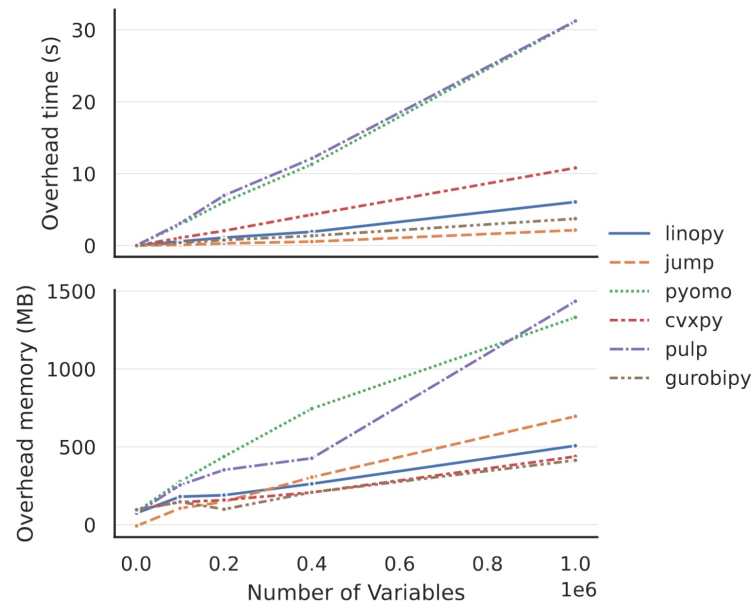


# Solving and summarising networks

## Hardware requirements:


- Building the model **can run locally** on most modern laptops. Very simple models can run with HiGHS solver.
- But access to a **commercial solver** and a larger **cluster/workstation** is required for solving problems (~250 GB RAM per scenario if resolution is very high)!

There is a **statistics module** in PyPSA designed to help with analysing solved networks and several **figures/maps** are created automatically.

Example result without sector-coupling

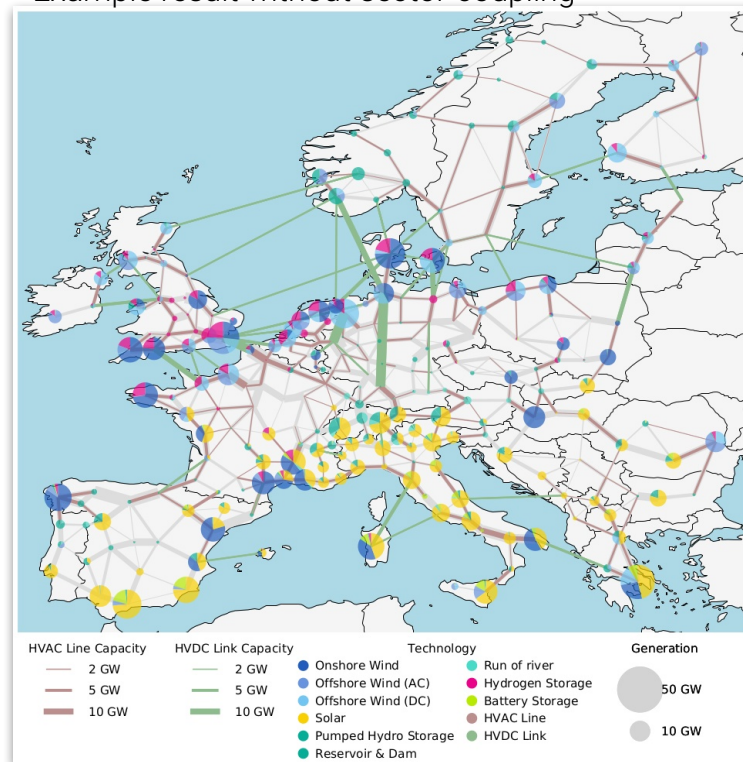

# PyPSA-Eur can be run on different **weather years**!

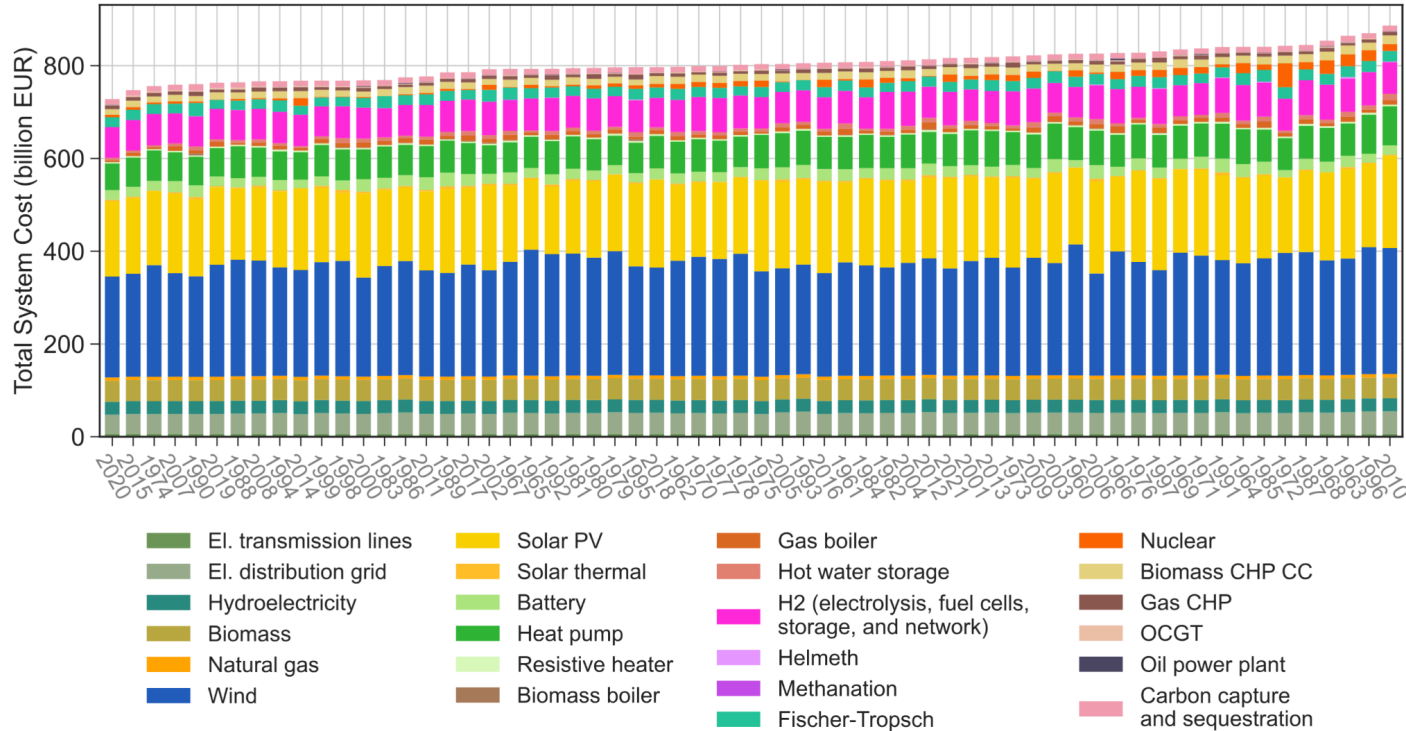

The years **2010**, **2013**, **2019** and **2023** are currently available “out of the box”.


Other years **1940-2024** require a few more steps.

We are planning to expand the number of “plug-and-play” years.

# What is configurable?


electricity-only  
examples

- Select subset of countries and focus countries (e.g. only DE)
- Select weather year (1940 - 2024 for ERA5)
- Specify CO<sub>2</sub> constraint and gas usage limit
- Tweak spatial resolution (between 41 and >1000 nodes)
- Tweak temporal resolution (from hourly to N-hourly)
- Customize cost assumptions (e.g. 2020, 2030, 2050)
- Parametrize technologies (e.g. wind turbine type, panel orientation)
- Define land use eligibility criteria (e.g. distance requirements)
- Pick a solver (HiGHS, Gurobi, CPLEX, Xpress...)
- Choose between greenfield or brownfield expansion

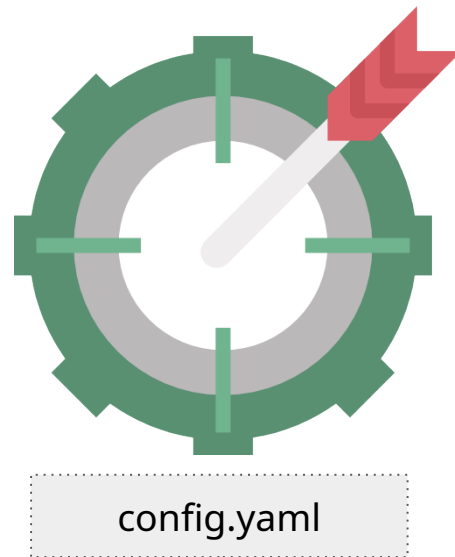

Let's look at this in more detail!





Q Search Ctrl + K

### Getting Started

- Introduction
- Installation
- Tutorial: Electricity-Only
- Tutorial: Sector-Coupled

### Configuration

- Wildcards
- Configuration**
- Foresight Options
- Techno-Economic Assumptions

### Rules Overview

- Retrieving Data
- Building Electricity Networks
- Building Sector-Coupled Networks
- Solving Networks
- Plotting and Summaries



# Configuration

PyPSA-Eur has several configuration options which are documented in this section and are collected in a `config/config.yaml` file. This file defines deviations from the default configuration (`config/config.default.yaml`); confer installation instructions at [Handling Configuration Files](#).

## Top-level configuration

“Private” refers to local, machine-specific settings or data meant for personal use, not to be shared. “Remote” indicates the address of a server used for data exchange, often for clusters and data pushing/pulling.

```
version: v2025.01.0
tutorial: false

logging:
  level: INFO
  format: '%(levelname)s:%(name)s:%(message)s'

private:
  keys:
    entsoe_api:

remote:
  ssh: ""
  path: ""
```

|          | Unit | Values        | Description  |
|----------|------|---------------|--|
| version  | –    | 0.x.x         | Version of PyPSA-Eur. Descriptive only.                                |
| tutorial | bool | {true, false} | Switch to retrieve the tutorial data set instead of the full data set. |
| logging  |      |               |  |



### Contents

Top-level configuration

- run
- foresight
- scenario
- countries
- snapshots
- enable
- co2 budget
- electricity
- atlite
- renewable
- conventional
- lines
- links
- transmission projects
- transformers
- load
- energy
- biomass
- solar\_thermal
- existing\_capacities
- sector
- industry
- costs
- clustering

<https://pypsa-eur.readthedocs.io/en/latest/configuration.html>

# Live Demo – Belgium / electricity-only / few days

Start with a dry-run:

Don't forget to activate your conda environment first!

```
$ snakemake solve_elec_networks --configfile config/test/config.electricity.yaml -n
```

Then execute the same command “for real” by dropping “-n” flag:

The “-j1” flag tells snakemake to run one job at a time.

```
$ snakemake -j1 solve_elec_networks --configfile config/test/config.electricity.yaml
```

To explore results, start a Jupyter notebook:

```
$ jupyter notebook
```

# Practical Phase

(electricity-only)

## 2) Install conda environment

Installation links:

- [Anaconda](#) (bigger download):
- [Miniconda](#) (recommended):

```
$ conda update conda
$ conda env create -f envs/environment.yaml
$ conda activate pypsa-eur
```

## 4) Explore PyPSA network in a Jupyter notebook

```
import pypsa
fn = "results/test-elec/networks/base_s_5_elec.nc"
n = pypsa.Network(fn)
n.statistics()
n.plot()
```

## 1) Download the repository

Open a terminal / CMD and type:


```
$ cd ~/path/to/my/directory
```

```
$ git clone
```

```
https://github.com/PyPSA/pypsa-eur.git
```

```
$ cd pypsa-eur
```

You can also download  
the repository as a ZIP  
by hand.



## 3) Run PyPSA-Eur tutorial with snakemake

Guide:

<https://pypsa-eur.readthedocs.io/en/latest/tutorial.html>

```
$ snakemake solve_elec_networks
--configfile
config/test/config.electricity.yaml
```

Users of Windows, add two lines to YAML:

```
run:
  use_shadow_directory: false
```


# Small exploratory configuration tasks

(electricity-only)

Go to <https://pypsa-eur.readthedocs.io/en/latest/configuration.html> and try to find out how to configure some of the settings for **electricity-only models** listed below:

1. Increase the maximum line loading from 70% to 100%.
2. Disable power transmission grid reinforcements.
3. Activate dynamic line rating with default settings.
4. Activate linearised transmission loss approximation.
5. Deactivate the estimation of existing renewable capacities.
6. Change the techno-economic assumptions to the year 2020.
7. Remove the option to build hydrogen or battery storage.

# Simplified workflow structure

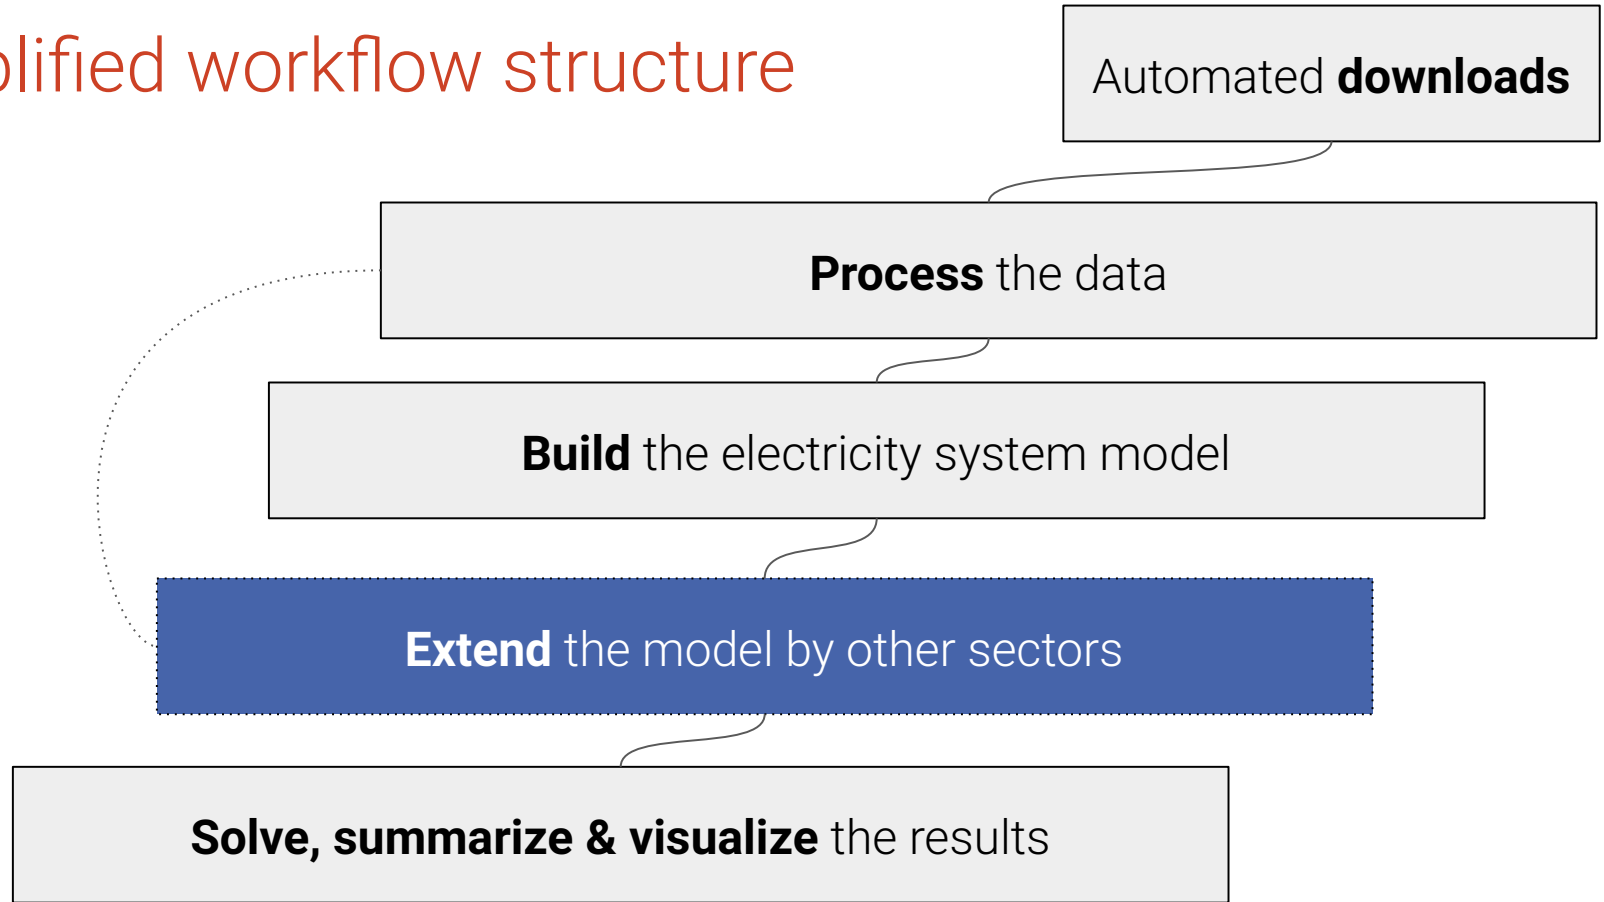


# Coupling with other sectors

Need to decarbonise **all sectors** in Europe obeying spatial and temporal constraints.


- **transport** sector (EVs, shipping, aviation)
- **heating** sector (district heating, individual)
- **industry** sector (steel, chemicals, ammonia, ...)
- industrial **feedstocks**
- **biomass** resources
- **carbon** management (CCUTS)
- hydrogen, CO<sub>2</sub> and gas **networks**
- **pathway** optimisation (myopic, perfect)

Boundaries between **energy** and **material model** blur.

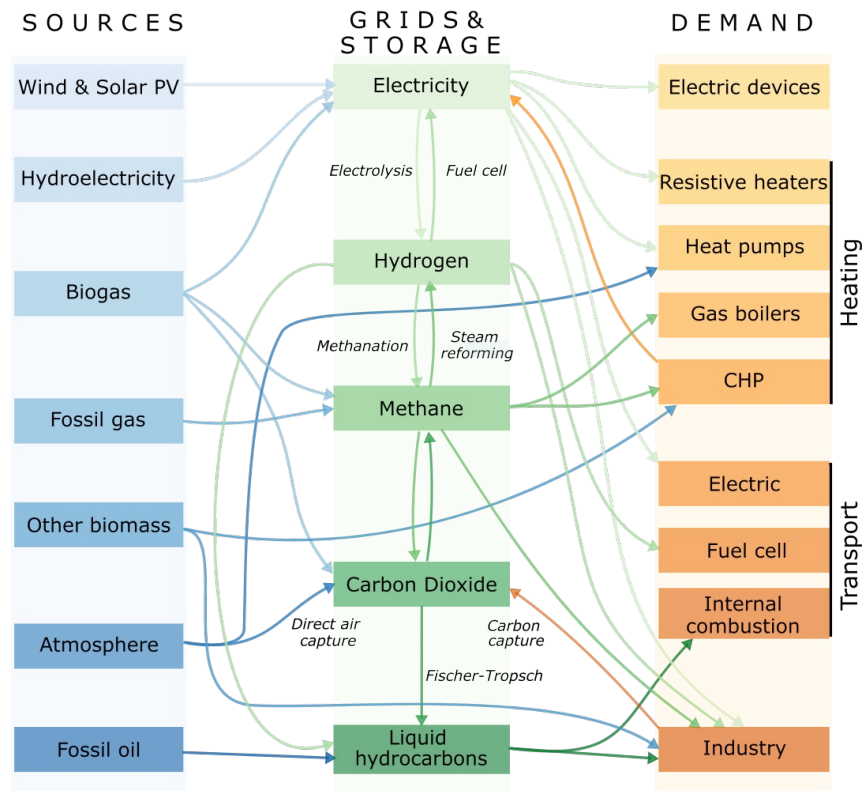




# Extension by other sectors requires more data!

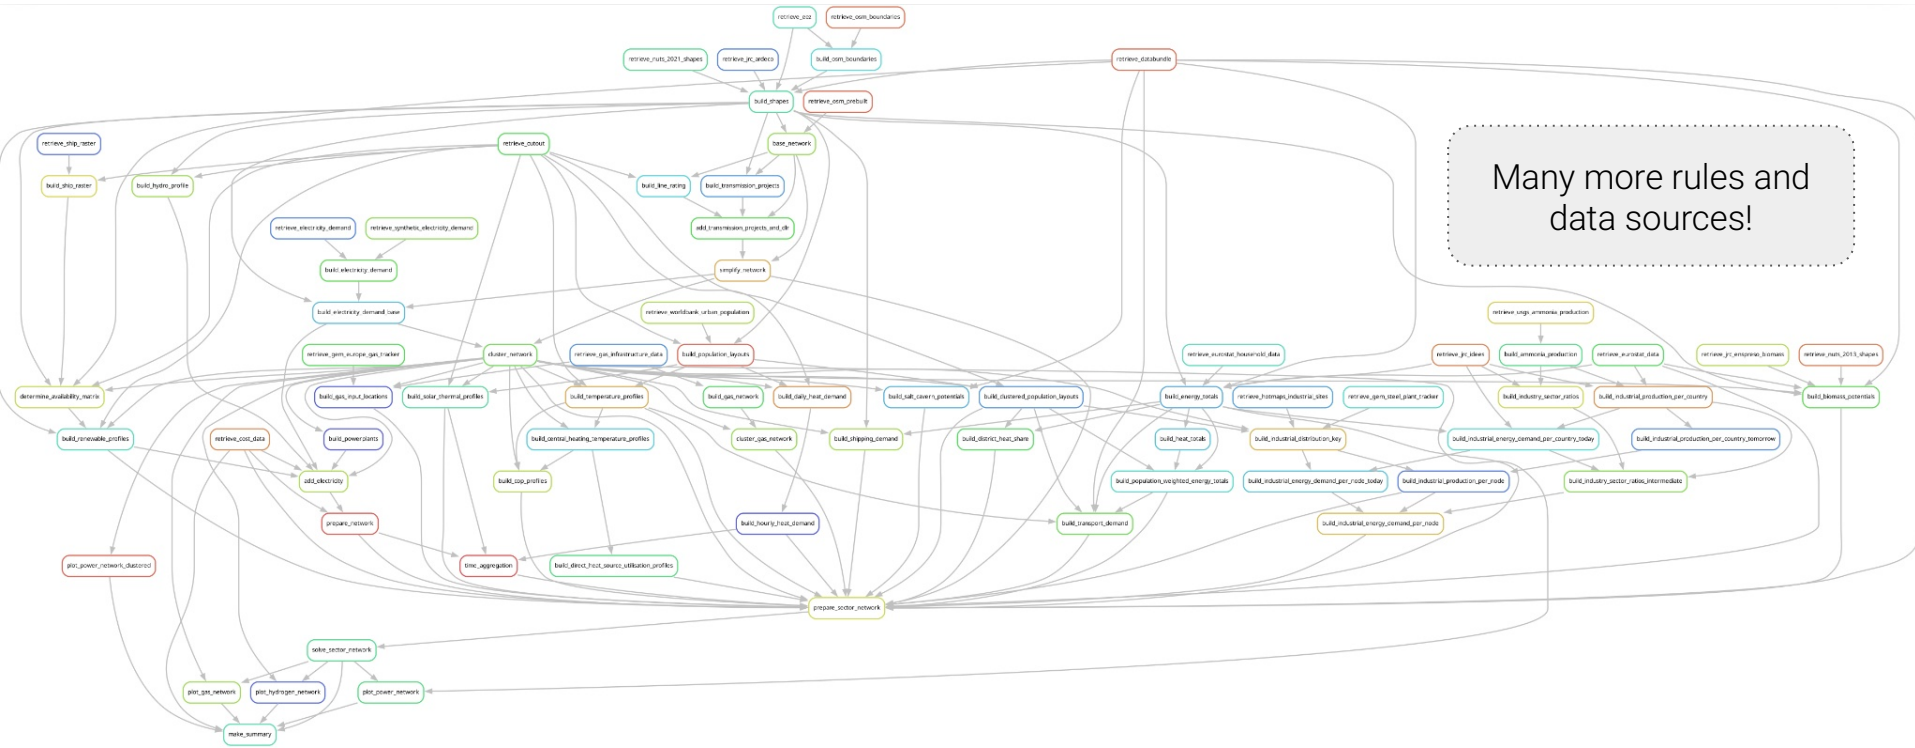

High-resolution version:


<https://tubcloud.tu-berlin.de/s/E7tx3BagXsKXLre>

# Temporal distribution of energy demands

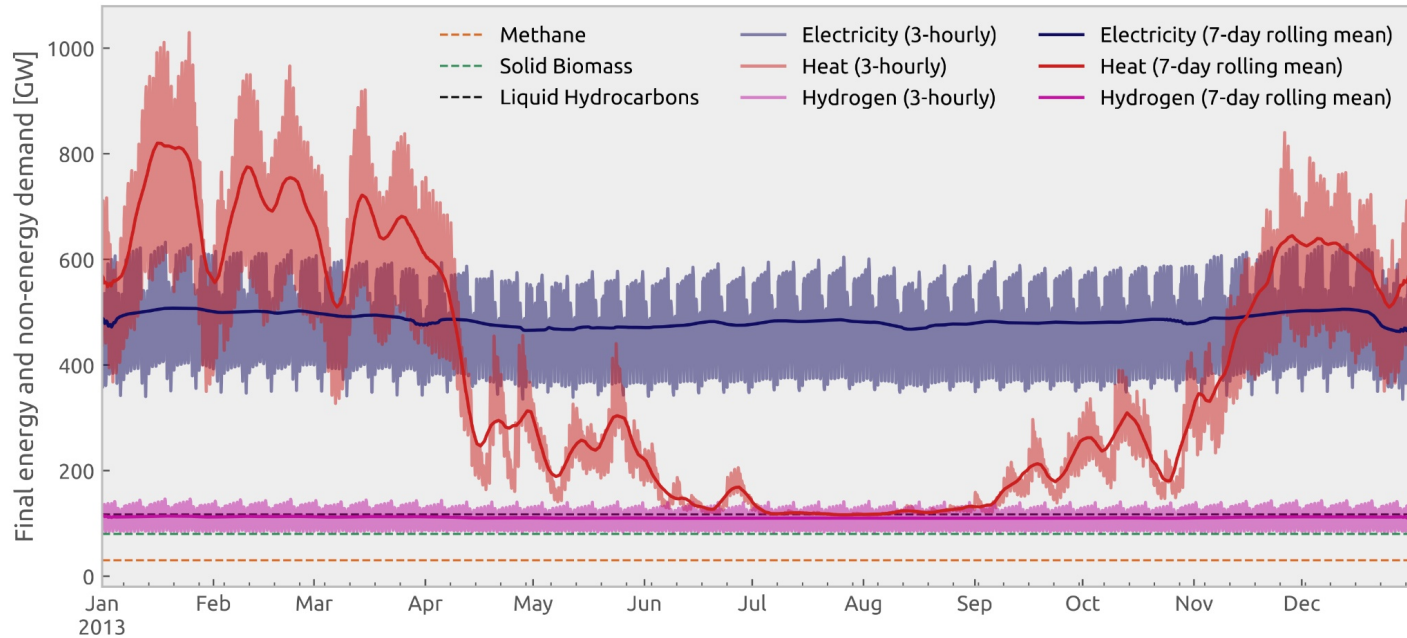

From a temporal perspective, the **seasonal variation of heat demand** adds a challenge – it can coincide [periods of low wind and solar availability](#) and [varies from year to year](#).



# Industry - Regionalisation based on Hotmaps

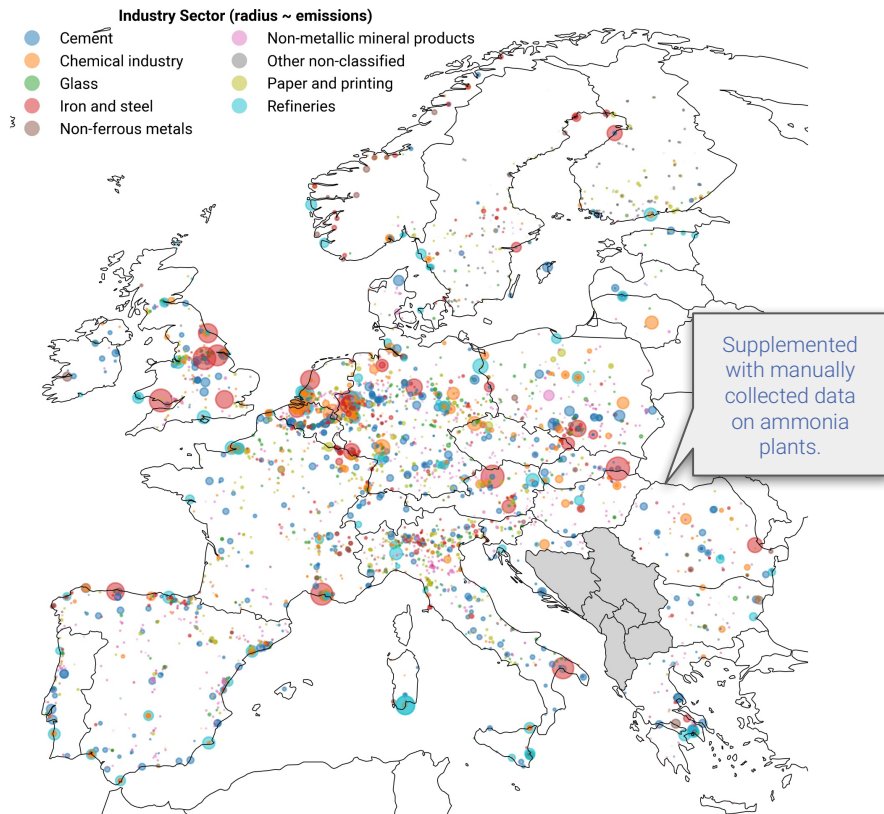

|                |   |
|----------------|---|
| Iron & Steel   | Phase-out integrated steelworks; increased recycling; rest from H <sub>2</sub> -DRI + EAF |
| Aluminium      | Methane for high-enthalpy heat; increased recycling                                       |
| Cement         | Solid biomass; capture of CO <sub>2</sub> emissions                                       |
| Ceramics       | Electrification   |
| Ammonia        | Gray, blue, green hydrogen  |
| Plastics       | Synthetic naphtha; MtO/MtA, increased recycling   |
| Other industry | Electrification; process heat from biomass  |
| Shipping       | Methanol, (oil), (liquid hydrogen), (LNG)   |
| Aviation       | Kerosene from Fischer-Tropsch or methanol   |

Modelling **industry relocation, high-temperature heat source & shipping fuels** endogenously is currently under development!


# Industry - Fuel & process switching / process emissions

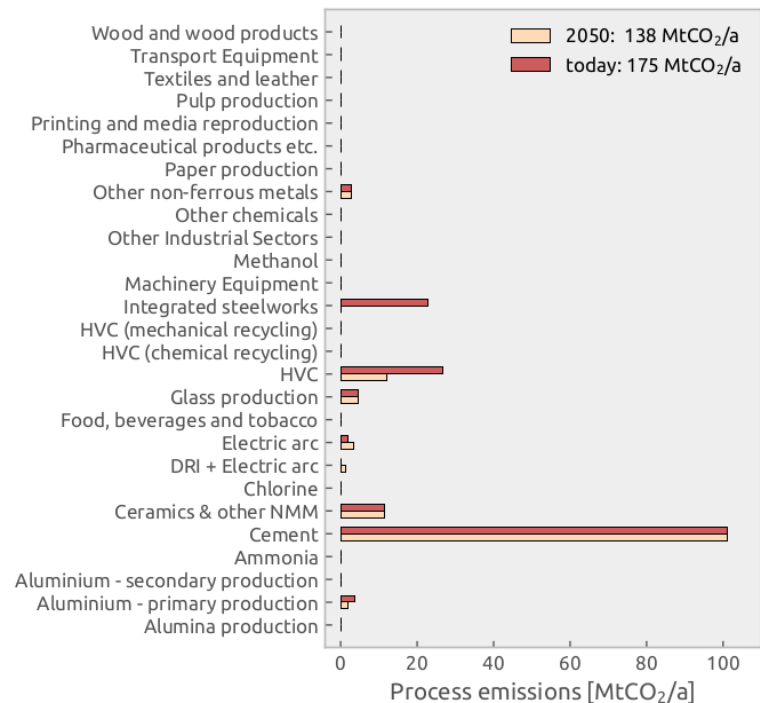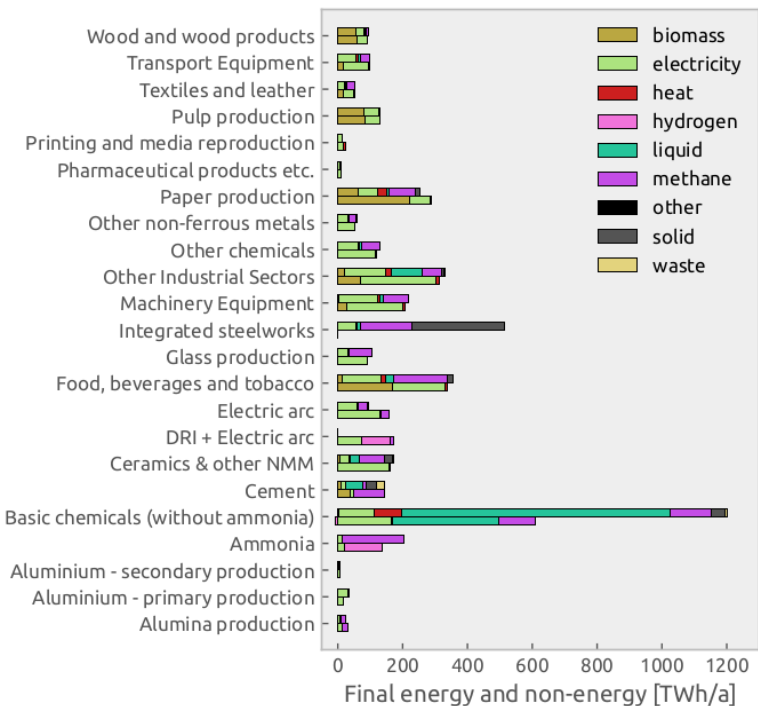


Currently, the most fuel & process switching in different industrial sectors is **exogenously configured** by the user. We're working to make these decisions **endogenous** to the model.

# Spatial distribution of energy demands

(a) electricity demand

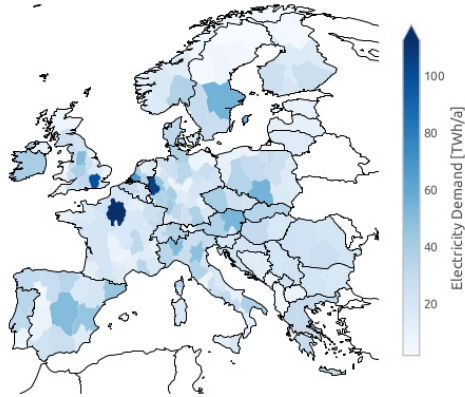


(b) hydrogen demand

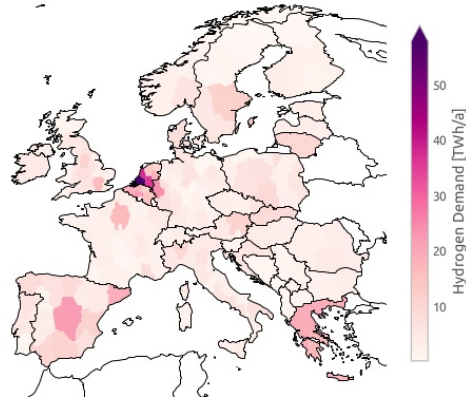


(e) oil-based product demand




(c) methane demand

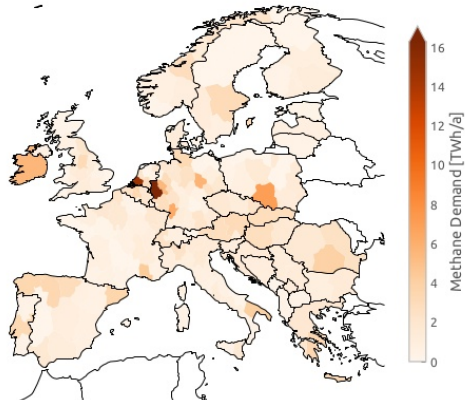

(d) heat demand

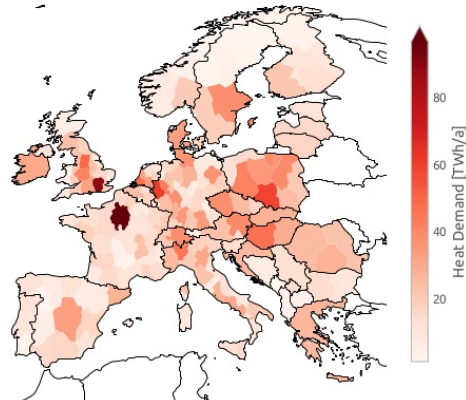

(f) solid biomass demand

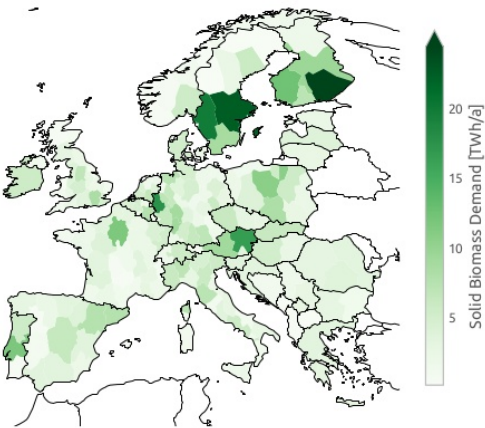



# Infrastructure - Gas network with H<sub>2</sub> retrofitting


Compiled from open  
**SciGRID\_gas** dataset.

Fossil gas enters at **LNG terminals** or **gas fields**.

Gas flow **physics** and **valve control** neglected 🖐️  
transport model.


Electricity demand for  
**compression** and **leakage**  
[configurable](#).

Pipelines can be **retrofitted**  
to H<sub>2</sub> with costs from [EHB](#).

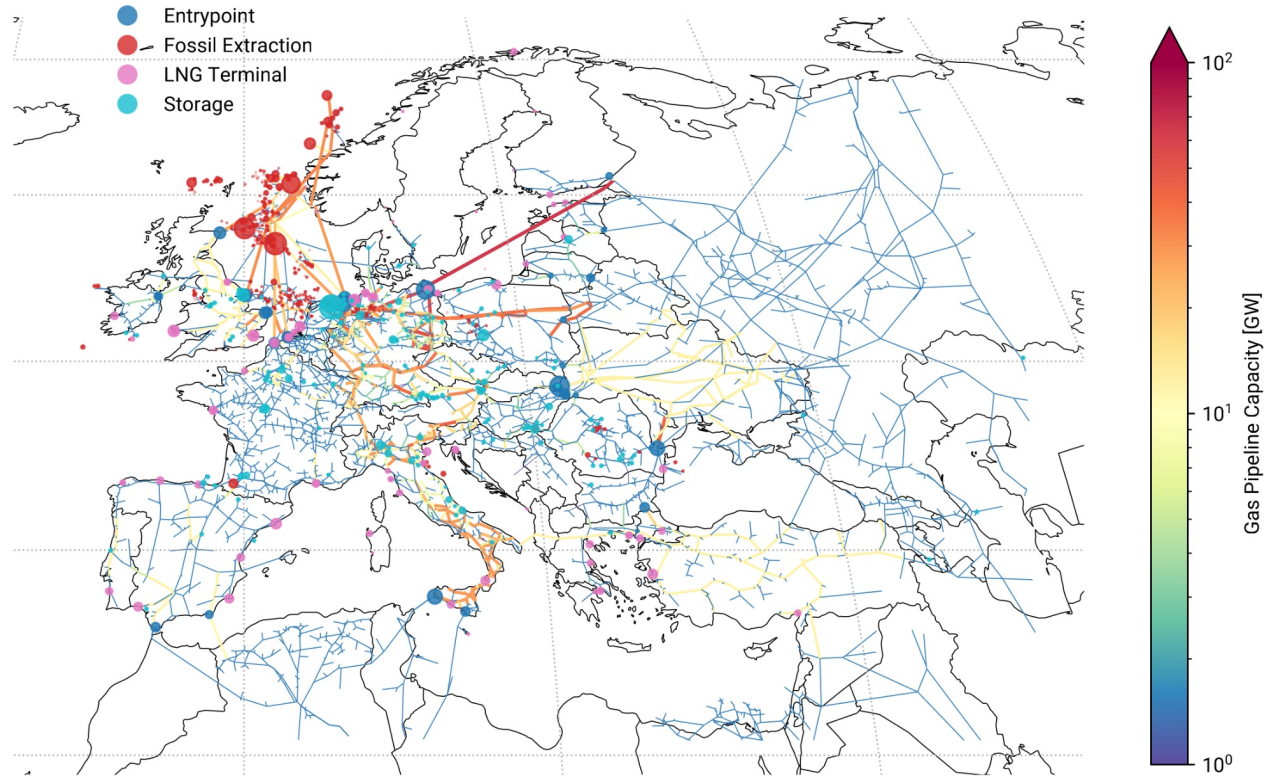





# Infrastructure - Hydrogen storage potentials

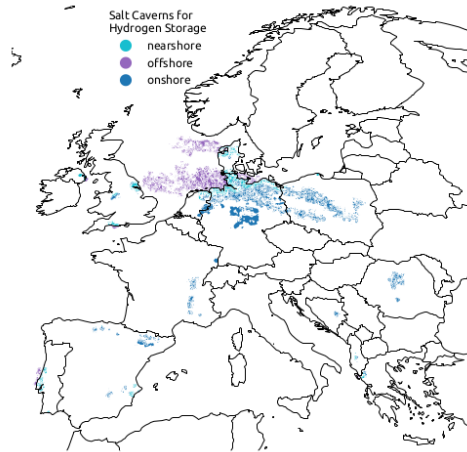


Onshore Salt Cavern H<sub>2</sub> Storage Potentials

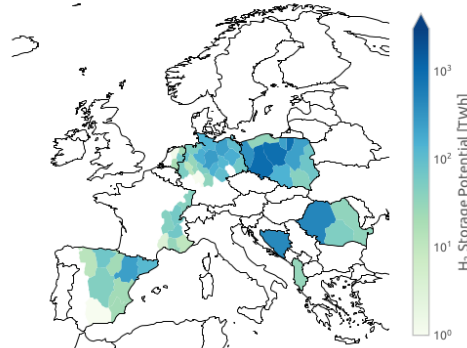

Offshore Salt Cavern H<sub>2</sub> Storage Potentials

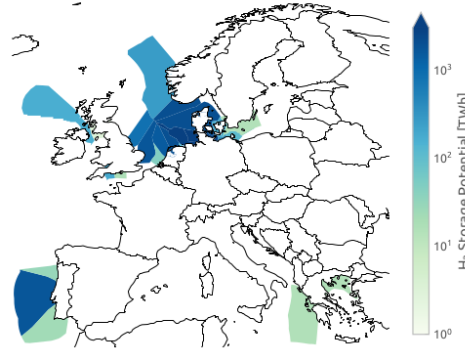

Nearshore Salt Cavern H<sub>2</sub> Storage Potentials

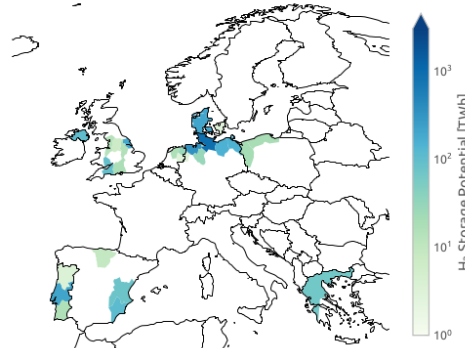


The regional distribution of **geological potential** to store hydrogen in **salt caverns** is considered.

The user can **configure** if onshore and/or offshore potentials can be used.

Dilara Gulcin Caglayan, Nikolaus Weber, Heidi U. Heinrichs, Jochen Linßen, Martin Robinius, Peter A. Kukla, Detlef Stolten, *Technical potential of salt caverns for hydrogen storage in Europe*, **International Journal of Hydrogen Energy**, Volume 45, Issue 11, 2020, 6793-6805, <https://doi.org/10.1016/j.ijhydene.2019.12.161>

# Infrastructure - Biomass from JRC ENSPRESO


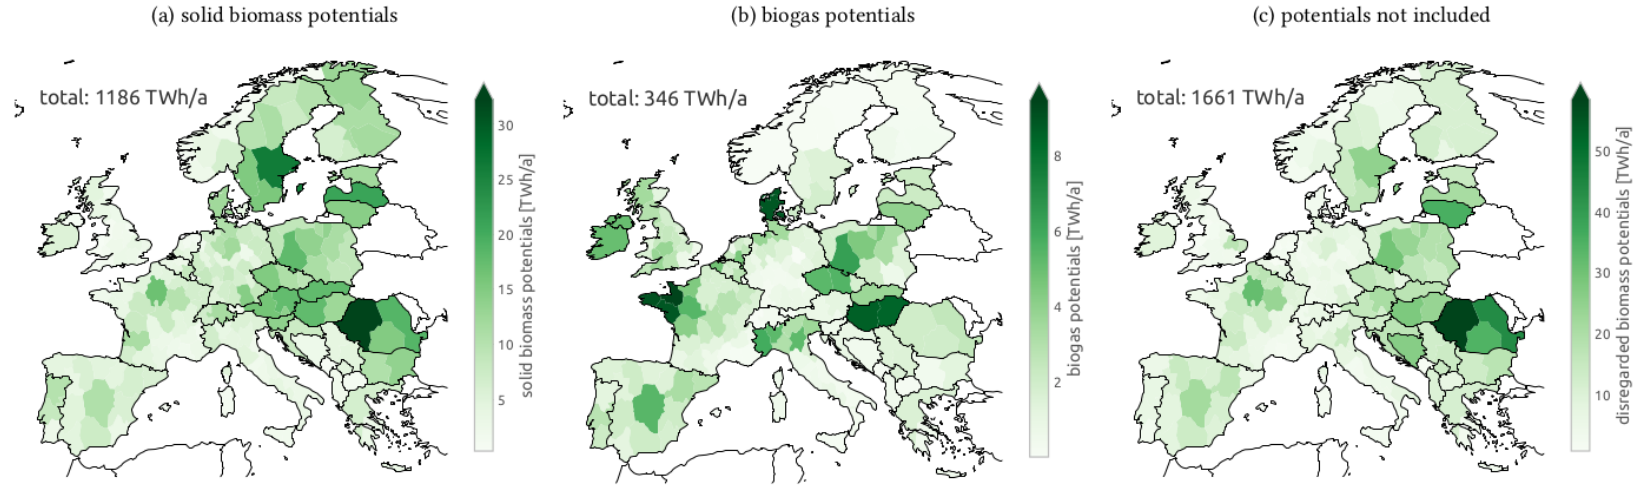


Biomass potentials are split between **solid biomass** and **biogas** (which can be, for instance, upgraded).

The user can configure low/medium/high potentials and what categories of biomass to consider (e.g. forest residues).

The default configuration only considers **residual biomass**, no energy crops.

# Infrastructure - Carbon management

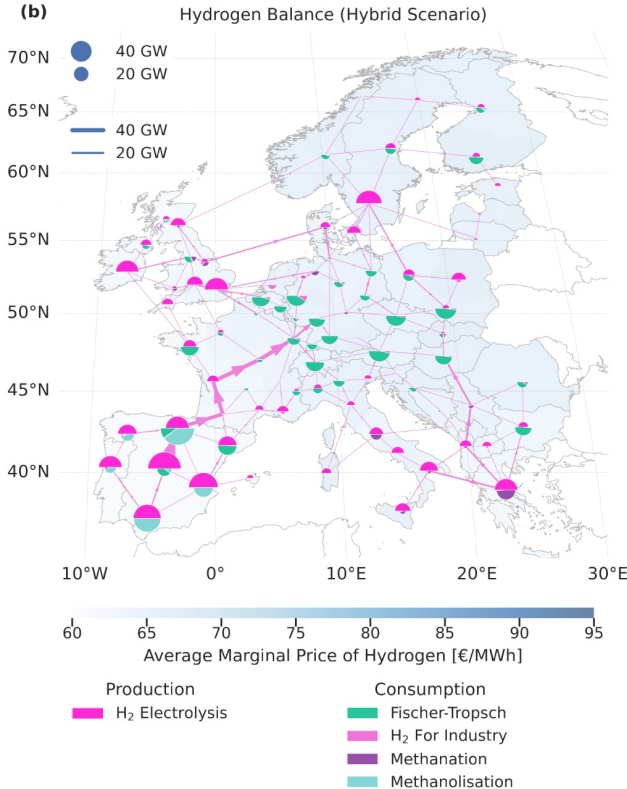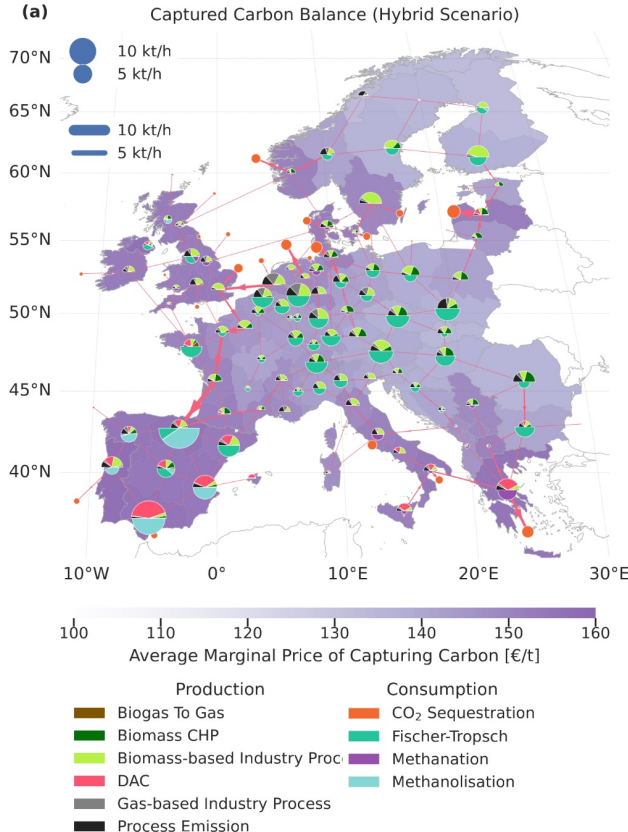


## Built-in carbon flows:

- **Capture:**  
DAC, process emissions, fossil / biomass CHP
- **Transport:**  
CO<sub>2</sub> pipelines
- **Storage:**  
intermediate storage and long-term geological sequestration
- **Utilization:**  
for synthetic carbonaceous fuels

# Infrastructure - Carbon sequestration potentials

Example: Offshore carbon sequestration potentials

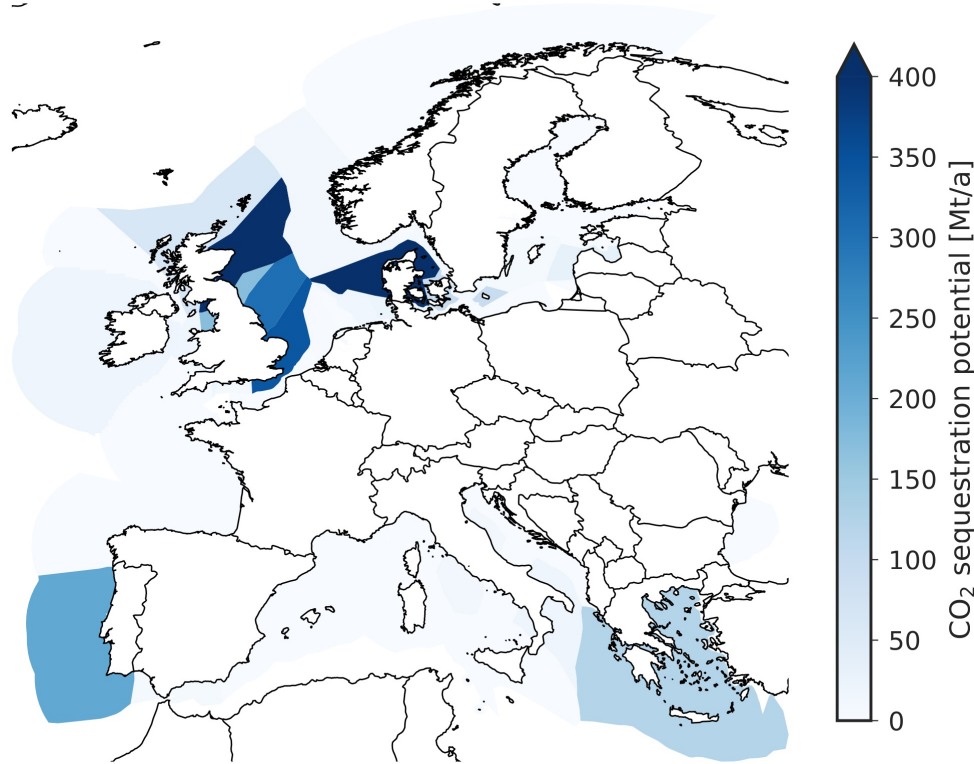


The user can **configure**


- onshore/offshore sequestration,
- gas fields/oil fields/aquifer, and
- low/medium/high potentials,

as well as a **total limit** on the annual sequestration, e.g. 250 Mt per year.

Data source:

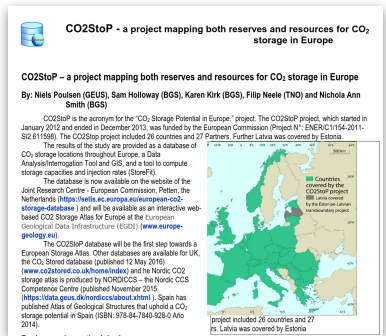

# Examples - Carbon management on a time axis

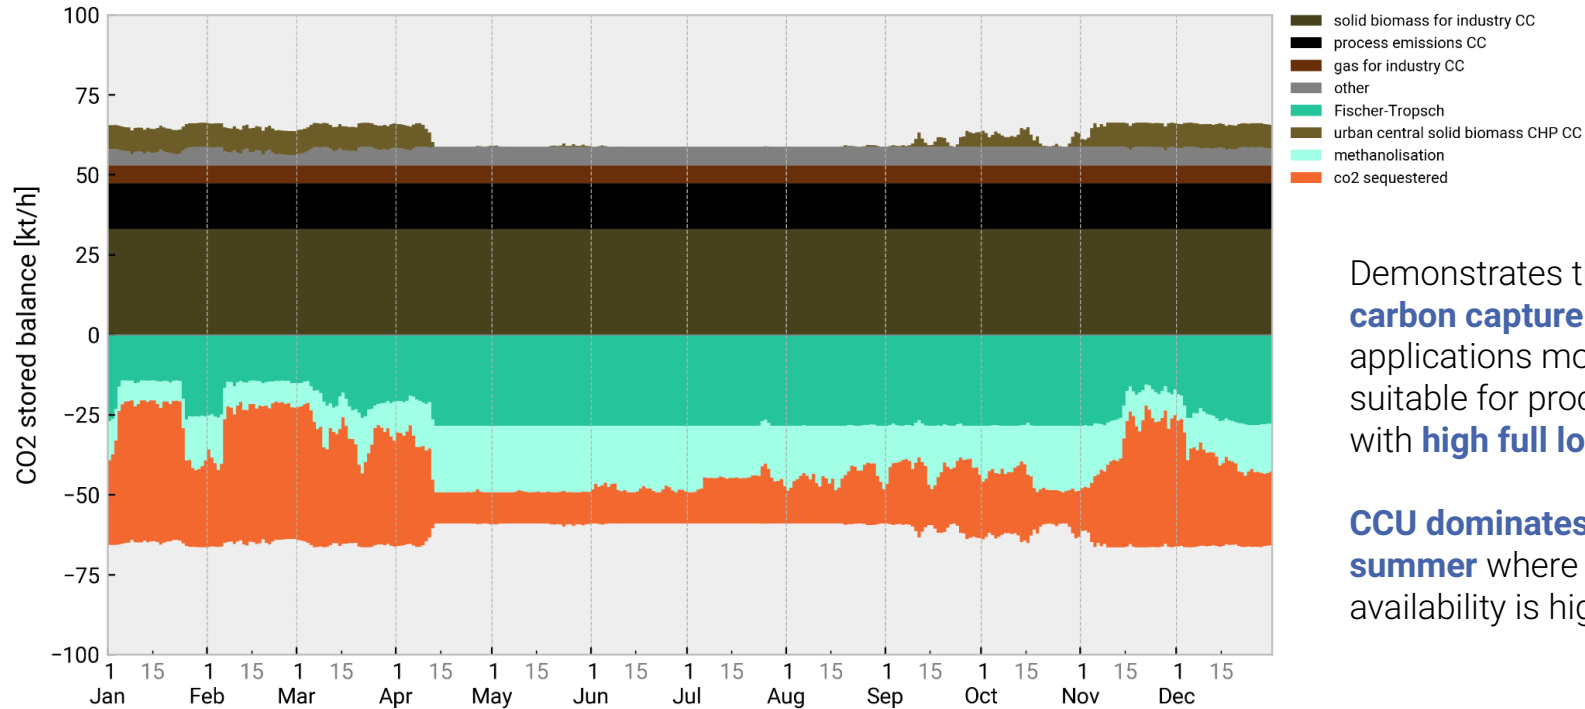

Demonstrates that **carbon capture** applications most suitable for processes with **high full load hours**.

**CCU dominates over summer** where solar availability is high.

# Heating - Tech for individual & district heating

## Decentral individual heating

can be supplied by:

- air- or ground-sourced heat pumps
- resistive heaters
- gas / oil / biomass / hydrogen boilers
- solar thermal
- small water tanks


Building renovations can be co-optimized to reduce space heating demand.

## District heating systems

can be supplied in urban areas by:




- air-sourced heat pumps
- resistive heaters
- gas / hydrogen / biomass / waste CHPs
- gas / oil / biomass / hydrogen boilers
- solar thermal
- long-duration hot water storage
- waste heat from industrial processes

CHP feasible dispatch:

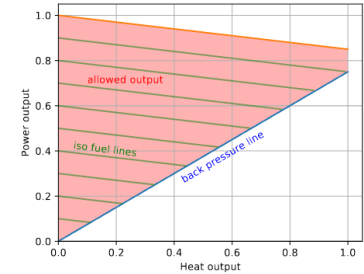




# Heating - Heat pumps as new variable supply tech

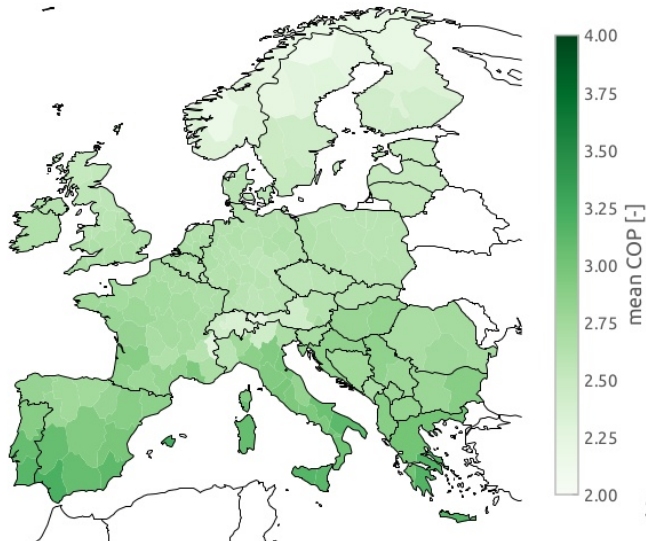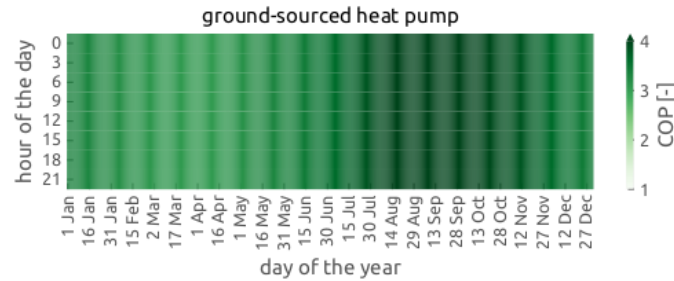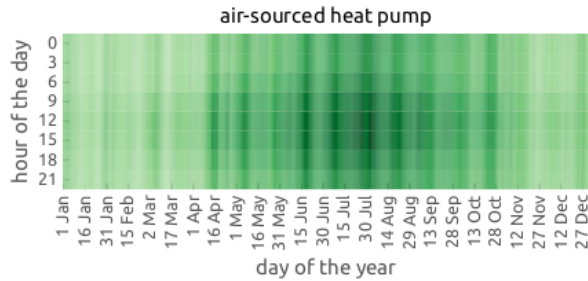


58

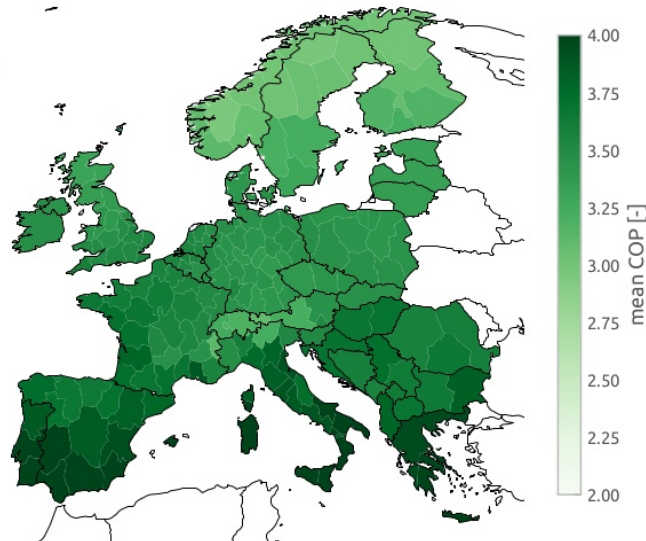


**Geothermal heat**  
sources have  
been integrated  
very recently!

# Heating - Example daily heat system balance

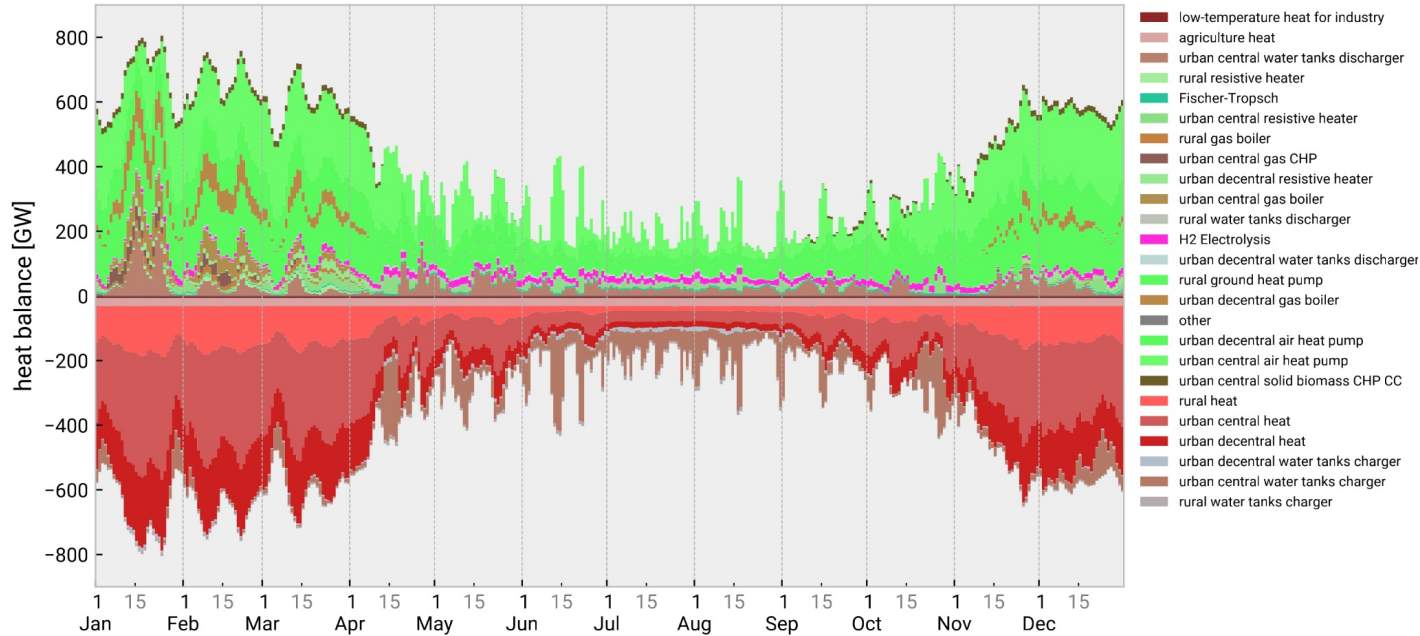

There are difficult periods in winter with **low** wind and solar, **high** space heating demand and **low** air temperatures, which are bad for air-sourced heat pump performance. In this case **gas boilers** and **CHP plants** jump in as backup.


# Transport - Electrification of land transport

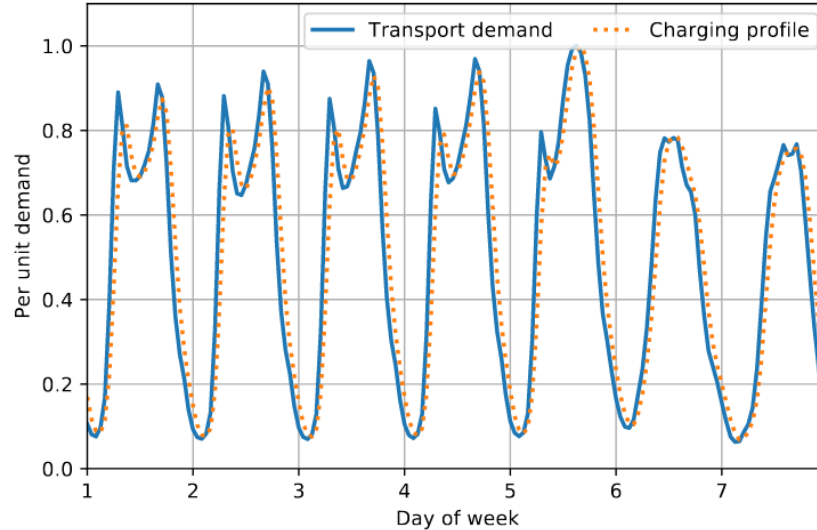

Weekly profile for the transport demand based on statistics gathered by the German Federal Highway Research Institute (BAST).

- Road and rail transport is fully electrified (vehicle costs are not considered)
- Because of higher efficiency of electric motors, final energy consumption 3.5 times lower than today at  $1100 \text{ TWh}_{el}/a$  for Europe
- In model can replace Battery Electric Vehicles (BEVs) with Fuel Cell Electric Vehicles (FCEVs) consuming hydrogen. Advantage: hydrogen cheap to store. Disadvantage: efficiency of fuel cell only 60%, compared to 90% for battery discharging.

# Transport - BEVs

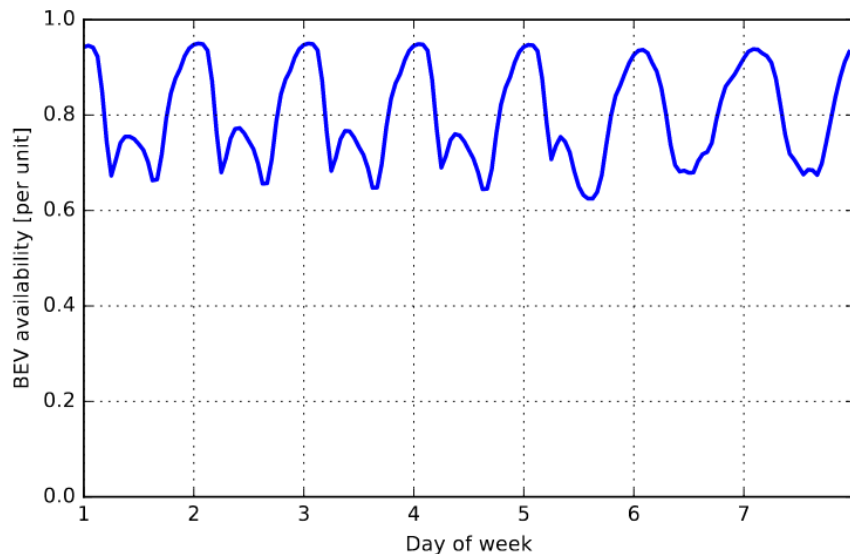

Availability (i.e. fraction of vehicles plugged in) of Battery Electric Vehicles (BEV).

- Passenger cars to Battery Electric Vehicles (BEVs), 50 kWh battery available and 11 kW charging power
- Can participate in DSM and V2G, depending on scenario (state of charge returns to at least 75% every morning)
- All BEVs have time-dependent availability, averaging 80%, max 95% (at night)
- No changes in consumer behaviour assumed (e.g. car-sharing/pooling)
- BEVs are treated as exogenous (capital costs NOT included in calculation)

# Technology choices - endogenous vs. exogenous

## Exogenous assumptions (modeller chooses):

- energy services demand (e.g. heat)
- district heating shares
- energy carrier shares for road transport
- kerosene for aviation
- methanol for shipping
- electrification & recycling in industry
- steel production with DRI + EAF

## Endogenous choices (model optimizes):

- change in electricity generation fleet
- transmission reinforcement
- capacities and locations of short and long-duration energy storage
- space and water heating technologies (including building renovations)
- all P2G/L/H/C
- supply of process heat for industry
- carbon capture (e.g. CHP, industry)

# Supply, consumption and storage options by carrier

Electricity (115 regions)

| Supply  | Withdrawal                         |
|---|------------------------------------|
| rooftop solar   | industry electricity               |
| utility-scale solar                                     | residential electricity            |
| onshore wind  | services electricity               |
| offshore wind<br>(fixed-pole/floating, AC/DC-connected) | agriculture electricity            |
| nuclear   | air-sourced heat pump              |
| hydro reservoirs  | ground-sourced heat pump           |
| pumped-hydro  | resistive heater                   |
| run-of-river  | electric vehicle charger           |
| import by HVDC link                                     | battery charger                    |
| gas CHP (w/wo CC)                                       | pumped-hydro                       |
| biomass CHP (w/wo CC)                                   | hydrogen pipeline<br>(compression) |
| gas turbine (OCGT)                                      | direct air capture                 |
| methanol turbine (OCGT)                                 | Haber-Bosch                        |
| hydrogen turbine (OCGT)                                 | electric arc furnace               |
| hydrogen fuel cell CHP                                  | direct iron reduction              |
| battery discharger                                      | distribution grid losses           |
| vehicle-to-grid   | transmission grid losses           |
|   | methanolisation                    |
|   | electrolysis                       |
| Grids & Storage   | distribution grid                  |
|   | transmission grid                  |
|   | battery storage                    |
|   | pumped-hydro storage               |
|   | electric vehicles                  |

Hydrogen (115 regions)

| Supply                                   | Withdrawal              |
|--|-------------------------|
| import by pipeline                       | Fischer-Tropsch         |
| import by ship                           | methanolisation         |
| electrolysis                             | electrobiofuels         |
| chlor-alkali electrolysis<br>(exogenous) | direct iron reduction   |
| steam methane reforming<br>(w/wo CC)     | Haber-Bosch             |
| ammonia cracker                          | hydrogen turbine (OCGT) |
|  | hydrogen fuel cell CHP  |
|  | methanol-to-kerosene    |
|  | Sabatier                |
| Grids & Storage                          | new pipelines           |
|  | retrofitted pipelines   |
|  | storage in salt caverns |
|  | storage in steel tanks  |

Liquid Hydrocarbons (not spatially resolved)

| Supply              | Withdrawal             |
|---------------------|------------------------|
| import by ship      | kerosene for aviation  |
| fossil oil refining | naphtha for industry   |
| Fischer-Tropsch     | diesel for agriculture |
| electrobiofuels     |                        |
| Storage             | hydrocarbon storage    |

Methanol (not spatially resolved)

| Supply          | Withdrawal              |
|-----------------|-------------------------|
| import by ship  | methanol turbine (OCGT) |
| methanolisation | methanol for shipping   |
|                 | methanol for industry   |
|                 | methanol-to-kerosene    |
| Storage         | hydrocarbon storage     |

Methane (not spatially resolved)

| Supply                     | Withdrawal                                |
|----------------------------|---|
| import by ship             | gas for high-T industry heat<br>(w/wo CC) |
| fossil gas                 | steam methane reforming<br>(w/wo CC)      |
| biogas upgrading (w/wo CC) | gas boiler (rural/urban)                  |
| Sabatier                   | gas CHP                                   |
|                            | gas turbine (OCGT)                        |
| Storage                    | hydrocarbon storage                       |

Ammonia (not spatially resolved)

| Supply         | Withdrawal             |
|----------------|------------------------|
| import by ship | ammonia cracker        |
| Haber-Bosch    | ammonia for fertilizer |
| Storage        | ammonia tank           |

# Supply, consumption and storage options by carrier

Heat (115 regions)

| Supply                                | Withdrawal  |
|---------------------------------------|---|
| air-sourced heat pump                 | residential heat  |
| ground-sourced heat pump (only rural) | services heat   |
| resistive heater                      | agriculture heat  |
| gas boiler                            | low-T industry heat                                       |
| biomass boiler                        | direct air capture  |
| solar thermal                         | water tank charger  |
| water tank discharger                 |   |
| biomass CHP (w/wo CC, only DH)        |   |
| gas CHP (w/wo CC, only DH)            |   |
| hydrogen fuel cell CHP (only DH)      |   |
| electrolysis (only DH)                |   |
| Haber-Bosch (only DH)                 |   |
| Sabatier (only DH)                    |   |
| Fischer-Tropsch (only DH)             |   |
| methanolisation (only DH)             |   |
| <b>Storage</b>                        | long-duration thermal storage (only DH)<br>hot water tank |

CO2 atmosphere (not spatially resolved)

| Supply                                 | Withdrawal                        |
|--|-----------------------------------|
| kerosene for aviation                  | solid biomass for industry (w CC) |
| diesel for agriculture                 | solid biomass CHP (w CC)          |
| methanol for shipping                  | biogas upgrading (w CC)           |
| methanol for industry                  | direct air capture                |
| naphtha for industry                   | electrobiofuels                   |
| gas boiler                             |                                   |
| gas CHP (w/wo CC)                      |                                   |
| gas turbine (OCGT)                     |                                   |
| methanol turbine (OCGT)                |                                   |
| process emissions (w/wo CC)            |                                   |
| fossil oil refining                    |                                   |
| gas for high-T industry heat (w/wo CC) |                                   |
| steam methane reforming (w/wo CC)      |                                   |

CO2 commodity (not spatially resolved)

| Supply                              | Withdrawal   |
|-------------------------------------|--|
| direct air capture                  | Fischer-Tropsch  |
| biogas upgrading (w CC)             | methanolisation  |
| gas CHP (w CC)                      | sequestration  |
| biomass CHP (w CC)                  | Sabatier   |
| steam methane reforming (w CC)      |  |
| process emissions (w CC)            |  |
| solid biomass for industry (w CC)   |  |
| gas for high-T industry heat (w CC) |  |
| <b>Storage</b>                      | intermediate storage in steel tank<br>long-term geological sequestration |



# Myopic pathway optimization

- Provide exogenous CO<sub>2</sub> emission **reduction path**.
- Optimise **start network** for e.g. 2025, starting with existing energy infrastructure.
- Take results from **2025 as input** for 2030 infrastructure optimisation, take 2030 results for next iteration, etc.
- The choice of **investment years** is arbitrary.
- **Perfect foresight pathway planning** is currently experimental (i.e. endogenous CO<sub>2</sub> budget).

Running many different scenarios with alternative configurations is straightforward and scalable in **snakemake!**



# Live Demo – very similar to electricity-only case

Start with a dry-run:

```
$ snakemake all --configfile config/test/config.overnight.yaml -n
```

Then execute the same command “for real” by dropping “-n” flag:

```
$ snakemake all --configfile config/test/config.overnight.yaml
```

And for myopic pathway optimisation:

```
$ snakemake all --configfile config/test/config.myopic.yaml
```

To explore results, start a Jupyter notebook:

```
$ jupyter notebook
```

# Practical Phase

(sector-coupled)

## 1) Run PyPSA-Eur sector-coupling tutorial with **snakemake**

Guide:

[https://pypsa-eur.readthedocs.io/en/latest/tutorial\\_sector.html](https://pypsa-eur.readthedocs.io/en/latest/tutorial_sector.html)

```
snakemake all --configfile config/test/config.overnight.yaml
```

## 2) Explore CSV files and images in **results** directory.

Users of Windows, add two lines to YAML:

```
run:  
  use_shadow_directory: false
```

# Small exploratory configuration tasks

(sector-coupled)

Go to <https://pypsa-eur.readthedocs.io/en/latest/configuration.html> and try to find out how to configure some of the settings for **sector-coupled models** listed below:

1. Disable vehicle-to-grid discharging.
2. Disable methanation as technology option.
3. Increase the carbon sequestration potential to 500 Mt/a.
4. Allow hydrogen underground storage also onshore.
5. Reduce the primary production of plastics by increasing recycling rates.
6. Change the settings of all transmission so that they are lossless.
7. Disable the use of PtX waste heat.

# Scenario management

**PyPSA-Eur** has integrated & scalable scenario management!

config/config.yaml

```
run:
  name: all
  scenarios:
    enable: true

scenario:
  clusters: [90]

sector:
  H2_network: true
  gas_network: true
  H2_retrofit: true

electricity:
  transmission_limit:
  vopt
```

With these two files  
configured, run:

```
$ snakemake all -n
```

and

```
$ snakemake all
```

config/scenarios.yaml

```
no-h2-network:
  sector:
    H2_network: false

no-grid-expansion:
  electricity:
    transmission: v1.0

no-to-both:
  sector:
    H2_network: false
  electricity:
    transmission:
v1.0

yes-to-both:
  sector:
    H2_network:
true
  electricity:
    transmission:
vopt
```

Closing remark – There is much more to explore!


# Additional Resources

Documentation

<https://pypsa-eur.readthedocs.io/>

Supplementary Material

[https://www.cell.com/joule/pdfExtended/S2542-4351\(23\)00266-0](https://www.cell.com/joule/pdfExtended/S2542-4351(23)00266-0)

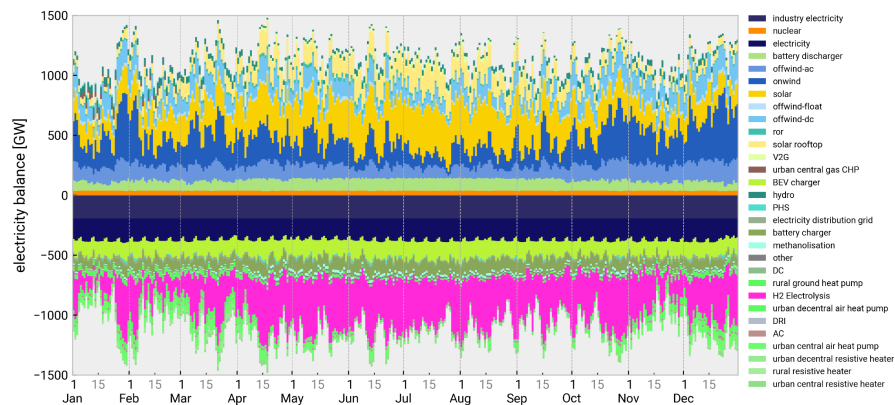


Joule

CellPress  
OPEN ACCESS

Article

## The potential role of a hydrogen network in Europe

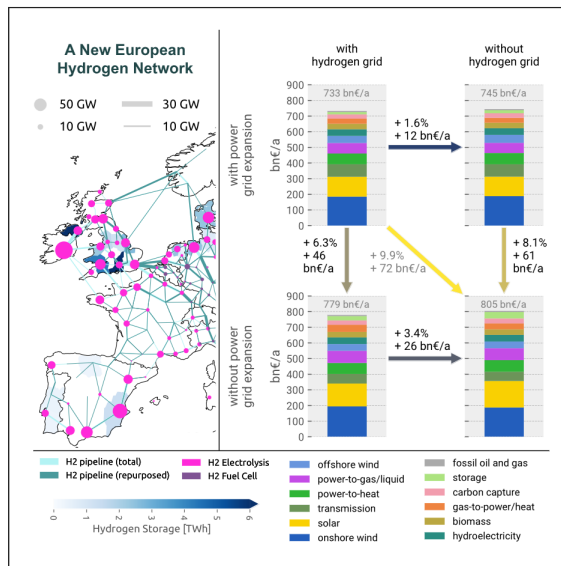

We examine the interplay between a continent-wide hydrogen network and electricity grid expansion in Europe to help balance variations in wind and solar energy supply. By adapting existing natural gas pipelines for hydrogen transport, energy system costs can be reduced, especially when power grid reinforcements are not possible. Both types of transmission infrastructure offer cost-effective options for achieving a European energy system with net-zero CO<sub>2</sub> emissions. However, with a 10% cost increase, it is possible to build neither.

Fabian Neumann, Elisabeth Zeyen, Marta Victoria, Tom Brown

[f.neumann@tu-berlin.de](mailto:f.neumann@tu-berlin.de)

### Highlights

Examination of the cost benefit of a European hydrogen network in net-zero emission scenarios

H<sub>2</sub> network reduces system costs by up to 3.4%, highest without power grid expansion

Between 64% and 69% of the hydrogen network uses retrofitted gas network pipelines

Power grid expansion saves more than hydrogen network, but strongest savings with both